

Enhanced Component Performance Study

Turbine-Driven Pumps

1998–2011

1 INTRODUCTION

This report presents a performance evaluation of turbine-driven pumps (TDPs) at U.S. commercial nuclear power plants. This report does not estimate values for use in probabilistic risk assessments (PRAs), but does evaluate component performance over time. The [2010 Component Reliability Update](#) [Reference 1], which is an update to Reference 2 ([NUREG/CR-6928](#)) reports TDP unreliability estimates using Equipment Performance and Information Exchange (EPIX) data from 1998–2010 and maintenance unavailability (UA) performance data using MSPI Basis Document data from 2002–2010 for use in PRAs.

The trend evaluations in this study are based on the operating experience failure reports from fiscal year (FY) 1998 through FY 2011 as reported in EPIX. The TDP failure modes considered are for standby systems: failure-to-start (FTS), failure-to-run ≤ 1 hour (FTR ≤ 1 H), failure-to-run > 1 hour (FTR > 1 H), and for normally running systems: FTS and failure-to-run (FTR). TDP train maintenance unavailability data for trending are from the same time period, as reported in the Reactor Oversight Program (ROP) and EPIX. In addition to the presentation of the component failure mode data and the UA data, an 8-hour unreliability is calculated and trended.

Previously, the study relied on operating experience obtained from licensee event reports, Nuclear Plant Reliability Data System (NPRDS), and EPIX. The EPIX database (which includes as a subset the Mitigating Systems Performance Index (MSPI) designated devices) has matured to the point where component availability and reliability can be estimated with a higher degree of assurance of accuracy. In addition, the population of data is much larger than the population used in the previous study.

The objective of the effort for the updated component performance studies is to obtain annual performance trends of failure rates and probabilities. An overview of the trending methods, glossary of terms, and abbreviations can be found in the [Overview and Reference](#) document on the Reactor Operational Experience Results and Databases web page.

The objective of the enhanced component performance study is to present an analysis of factors that could influence the system and component trends in addition to annual performance trends of failure rates and probabilities. The factors analyzed for the TDP component are the differences in failures between total demands and actual unplanned (ESF) demands (Section 6.3). Statistical analyses of the differences are performed and results showing whether pooling is acceptable across these factors are shown. In addition, engineering analyses were performed with respect to time period and failure mode (Section 6.4). The factors analyzed are: sub-component, failure cause, recovery, and detection method.

2 SUMMARY OF FINDINGS

The results of this study are summarized in this section. Of particular interest is the existence of any statistically significant¹ increasing trends. In this update, no highly statistically significant increasing trends were identified in the TDP results.

Statistically significant decreasing trends were identified in the TDP results for the following:

- Failure rate estimate trend for normally running systems (MFW), industry-wide TDP FTR trend. (see Figure 5)
- Normally running TDP run hours per reactor critical year. (see Figure 16)
- Frequency (events per reactor year) of FTR events, normally running TDPs. (see Figure 18)

Highly statistically significant decreasing trends were identified in the TDP results for the following:

- Frequency (events per reactor year) of start demands, normally running TDPs. (see Figure 15)

An ongoing concern in the industry is whether industry data adequately represent standby component performance during unplanned (ESF) demands. Section 6.3 shows the results of the consistency check between industry data and ESF detected failure data. The consistency checks using unplanned demand data indicate that the FTR>1H failure observations are not consistent with their industry-average distribution from Table 2, but seem to perform better (upper 5%). The unplanned demand FTS is consistent with the industry-average distribution. The unplanned demand failure mode observation FTR<1H and the Total TDP unreliability are not consistent and lie in the lower 95% (degraded performance) meaning that the TDP performs worse than the industry average distribution. Since most of the industry experience comes from testing, the unplanned demand performance appears to challenge the equipment more than the testing does.

¹ Statistically significant is defined in terms of the 'p-value.' A p-value is a probability indicating whether to accept or reject the null hypothesis that there is no trend in the data. P-values of less than or equal to 0.05 indicate that we are 95% confident that there is a trend in the data (reject the null hypothesis of no trend.) By convention, we use the "Michelin Guide" scale: p-value < 0.05 (statistically significant), p-value < 0.01 (highly statistically significant); p-value < 0.001 (extremely statistically significant).

3 FAILURE PROBABILITIES AND FAILURE RATES

3.1 Overview

The industry-wide failure probabilities and failure rates of TDPs have been calculated from the operating experience for FTS, FTR \leq 1H, FTR $>$ 1H, and FTR. The TDP data set obtained from EPIX includes TDPs in the systems listed in Table 1. Table 2 shows industry-wide failure probability and failure rate results for the TDP from Reference 1.

Table 1. TDP systems.

System	Description	Standby	Normally Running
AFW	Auxiliary feedwater	74	
HPCI	High pressure coolant injection	28	
MFW	Main feedwater		40
RCIC	Reactor core isolation cooling	31	
Total		133	40

The TDPs are assumed to operate both when the reactor is critical and during shutdown periods with sufficient steam pressure. The number of TDPs in operation is assumed to be constant throughout the study period. All demand types are considered—testing, non-testing, and, as applicable, emergency safeguard feature (ESF) demands.

Table 2. Industry-wide distributions of p (failure probability) and λ (hourly rate) for TDPs.

Operation	Failure Mode	5%	Median	Mean	95%	Distribution		
						Type	α	β
Standby	FTS	2.88E-04	4.41E-03	6.49E-03	1.98E-02	Beta	0.94	1.441E+02
	FTR \leq 1H	2.07E-04	3.03E-03	4.43E-03	1.34E-02	Beta	0.96	2.164E+02
	FTR $>$ 1H	9.10E-04	1.52E-03	1.56E-03	2.35E-03	Gamma	12.50	8.028E+03
Running/ Alternating	FTS	3.25E-04	5.89E-03	8.93E-03	2.79E-02	Beta	0.88	9.728E+01
	FTR	1.44E-06	7.67E-06	9.34E-06	2.29E-05	Gamma	1.79	1.919E+05

3.2 TDP Failure Probability and Failure Rate Trends

The trends are shown for industry standby (Stby) and for industry normally running (NR) results.

Trends in the standby TDP failure probabilities and failure rates are shown in Figure 1 to Figure 3. The data for the trend plots are contained in Table 9 to Table 11. The standby systems from Table 1 are trended together for each failure mode. Trends in the failure probabilities and failure rates for normally operating TDPs are shown in Figure 4 and Figure 5. The data for the trend plots are contained in Table 12 and Table 13.

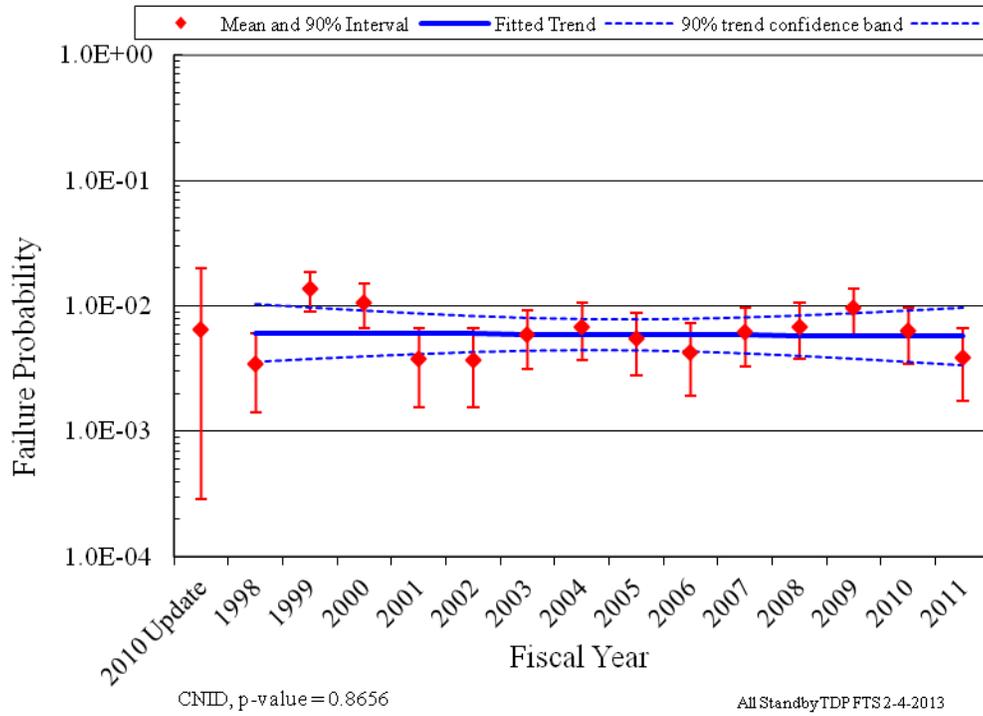


Figure 1. Failure probability estimate trend for standby systems, industry-wide TDP FTS trend.

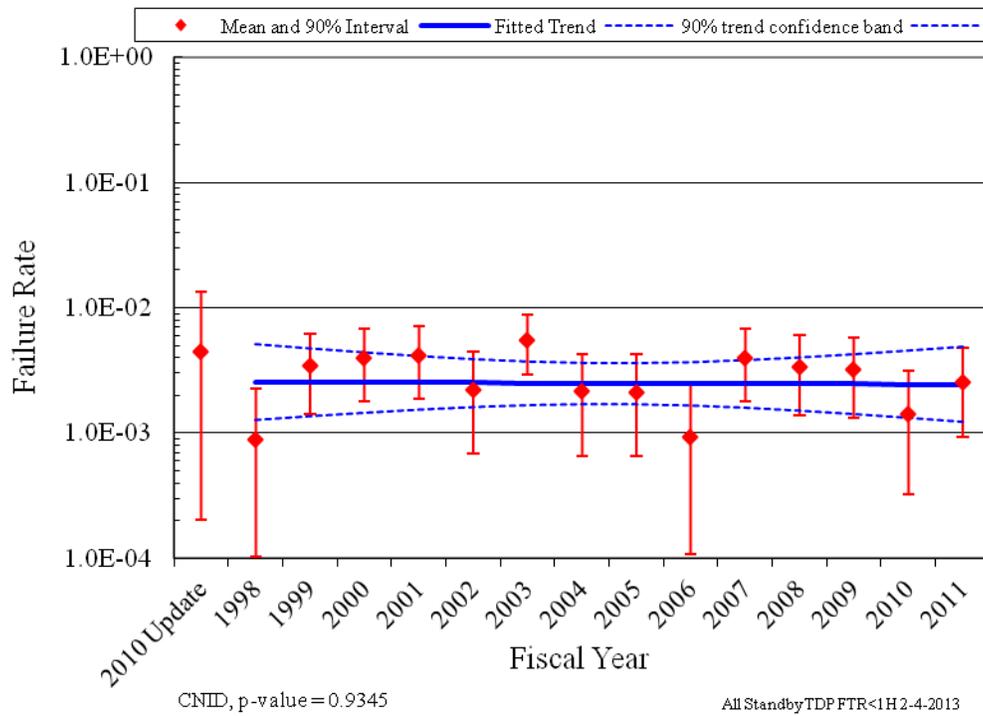


Figure 2. Failure probability estimate trend for standby systems, industry-wide TDP FTR≤1H trend.

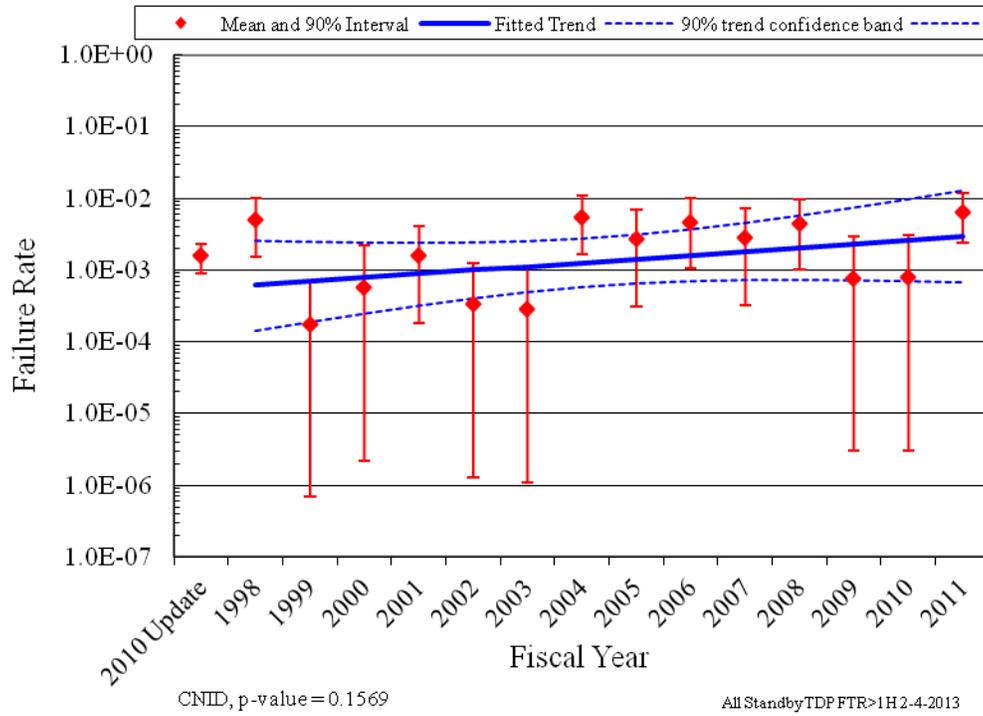


Figure 3. Failure rate estimate trend for standby systems, industry-wide TDP FTR > 1H trend.

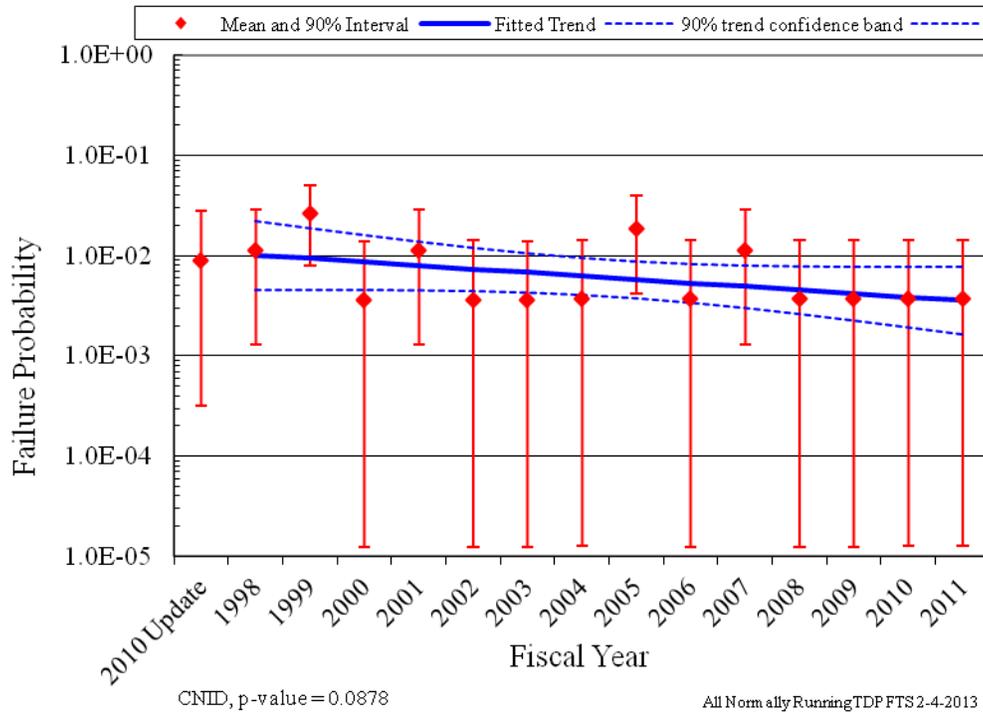


Figure 4. Failure probability estimate trend for normally running systems (MFW), industry-wide TDP FTS trend.

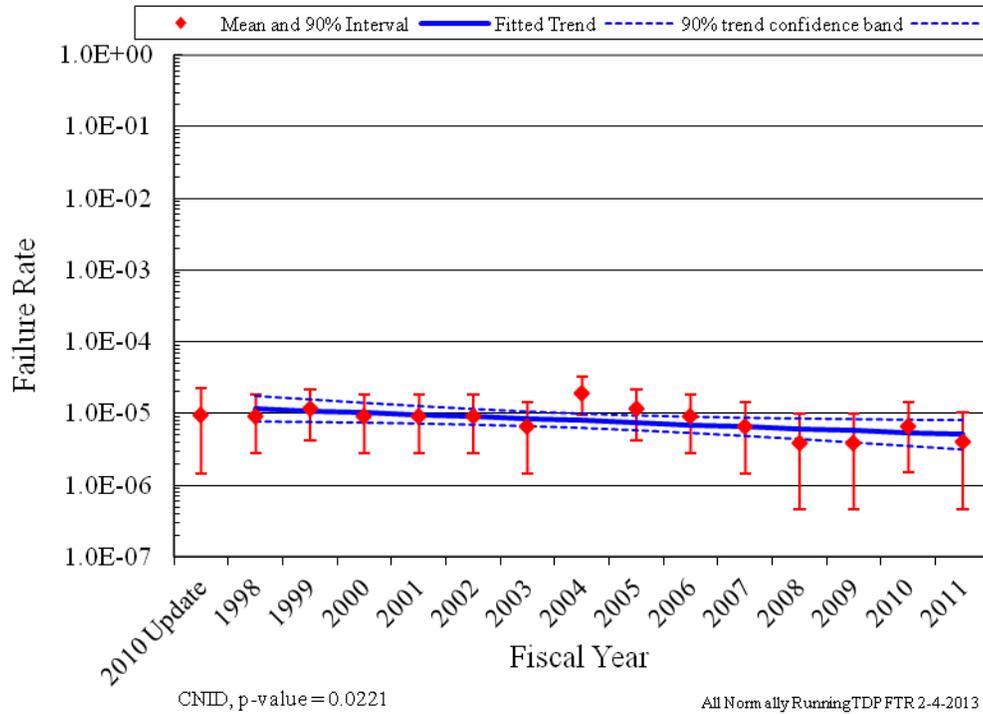


Figure 5. Failure rate estimate trend for normally running systems (MFW), industry-wide TDP FTR trend.

In the plots, the means of the posterior distributions from the Bayesian update process were trended across the years. The posterior distributions were also used for the vertical bounds for each year. The 5th and 95th percentiles of these distributions give an indication of the relative variation from year to year in the data. When there are no failures, the interval tends to be larger than the interval for years when there are one or more failures. The larger interval reflects the uncertainty that comes from having little information in that year’s data. Such uncertainty intervals are determined by the prior distribution. In each plot, a relatively “flat” constrained noninformative prior distribution (CNID) is used, which has large bounds.

The horizontal curves plotted around the regression lines in the graphs show 90 percent simultaneous confidence bands for the fitted lines. The simultaneous confidence band bounds are larger than ordinary confidence intervals for the trended values because they form a band that has a 90% probability of containing the entire line. In the lower left hand corner of the trend figures, the regression p-values are reported. They come from a statistical test on whether the slope of the regression line might be zero. Low p-values indicate that the slopes are not likely to be zero, and that trends exist.

Further information on the trending methods is provided in Section 2 of the [Overview and Reference](#) document. A final feature of the trend graphs is that the baseline industry values from Table 2 are shown for comparison.

4 UNAVAILABILITY

4.1 Overview

The industry-wide test or maintenance unavailability (UA) of TDP trains has been calculated from the operating experience. UA data are for TDP trains, which can include more than just the TDP. However, in most cases the TDP contributes the majority of the UA reported. Table 3 shows overall results for the TDP from Reference 1 based on UA data from MSPI Basis Documents, covering 2002 to 2010. In the calculations, planned and unplanned unavailable hours for a train are combined.

Table 3. Industry-wide distributions of unavailability for TDPs.

Description	Mean	Distribution	α	β
Turbine Driven Pump Test Or Maintenance (AFW)	5.33E-03	Beta	1.93	360.48
Turbine Driven Pump Test Or Maintenance (ALL)	7.76E-03	Beta	2.17	277.36
Turbine Driven Pump Test Or Maintenance (HPCI)	1.15E-02	Beta	11.88	1024.52
Turbine Driven Pump Test Or Maintenance (RCIC)	1.02E-02	Beta	5.65	550.06

4.2 TDP Unavailability Trends

For the 1998-2011 period, the following are overall maintenance unavailability data. Note that these data do not supersede the data in Table 3 for use in risk assessments.

The trend in standby TDP train unavailability is shown in Figure 6. The data for this figure is in Table 14. The TDPs in systems AFW, HPCI, and RCIC are pooled and trended (these are the systems with maintenance unavailability data currently analyzed). The trend chart shows the results of using data for each year's component unavailability data over time. The yearly (1998–2011) unavailability and reactor critical hour data were obtained from the ROP (1998 to 2001) and EPIX (2002 to 2011) data for the TDP component. The total downtimes during operation for each plant and year were summed, and divided by the corresponding number of TDP-reactor critical hours. Unavailability data for shutdown periods are not reported.

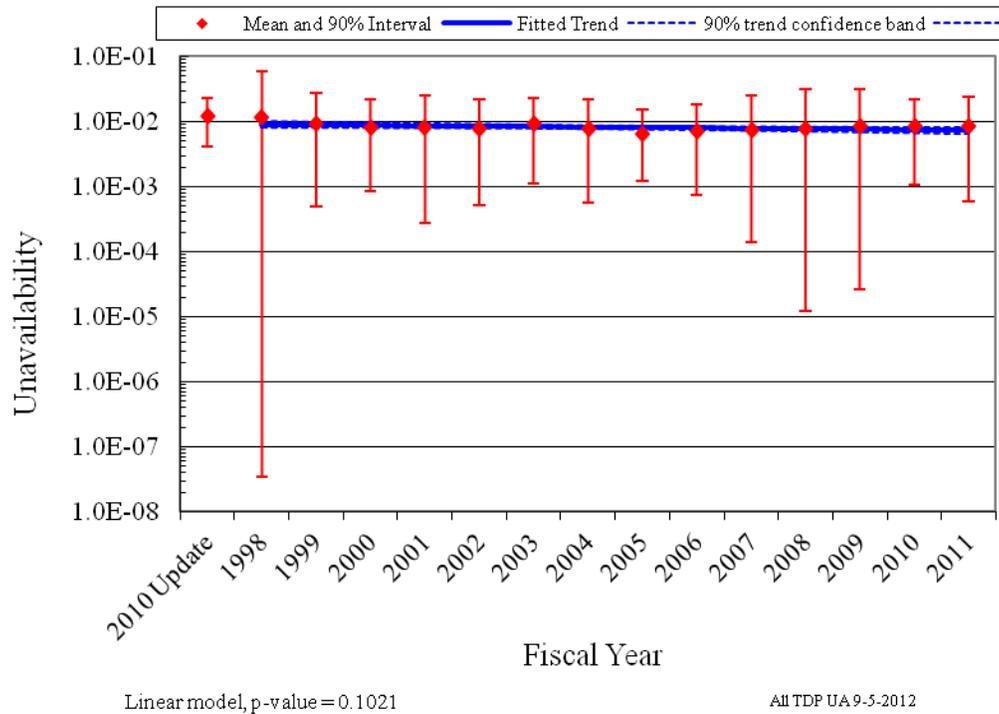


Figure 6. Pooled AFW, HPCI, and RCIC TDP UA trend.

The mean and variance for each year is the sample mean and variance calculated from the plant-level unavailabilities for that year. The vertical bar spans the calculated 5th to 95th percentiles of the beta distribution with matching means.

For the trend graphs, a least squares fit is sought for the linear or logit model. Section 3 in the [Overview and Reference](#) document provides further information. In the lower left hand corner of the trend figures, the p-value is reported.

5 TDP UNRELIABILITY TRENDS

Trends in total component unreliability are shown in Figure 7 and Figure 8. Plot data for these figures are in Table 15 and Table 16, respectively. Total unreliability is defined as the result of an OR gate with the FTS, $FTR \leq 1H$, $FTR > 1H$ (or FTR), and UA as basic event inputs. The $FTR > 1H$ is calculated for 7 hours and the FTR is calculated for 8 hours to provide the results for an 8-hour mission. Since the normally running systems TDP components do not have UA data or the $FTR \leq 1H$ data, there is no UA or $FTR \leq 1H$ input to the OR gate for that calculation. The trending method is described in more detail in Section 4 of the [Overview and Reference](#) document. In the lower left hand corner of the trend figures, the regression method is reported.

The standby systems from Table 2 are trended together.

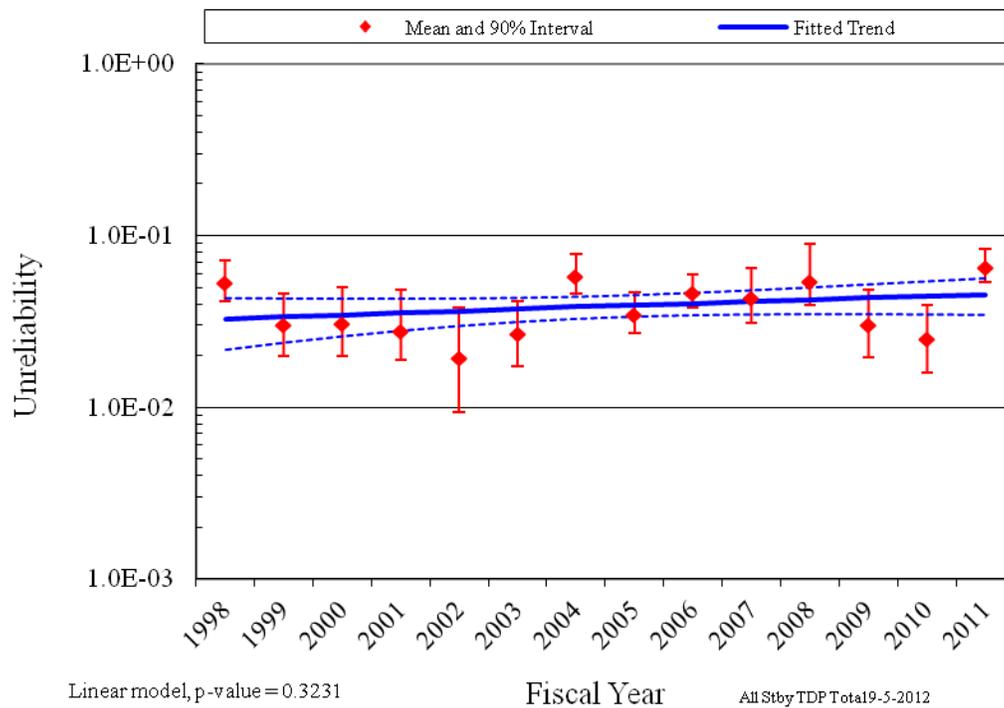


Figure 7. Standby systems, industry-wide TDP unreliability trend (8-hour mission).

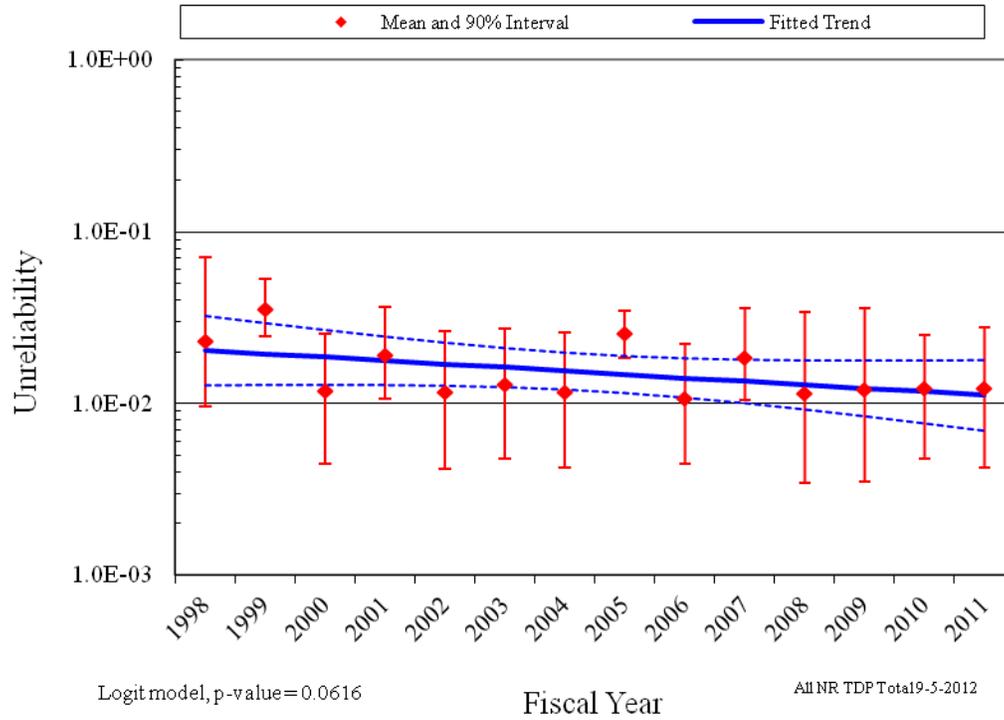


Figure 8. Normally running systems (MFW), industry-wide TDP unreliability trend (8-hour mission).

6 ENGINEERING TRENDS


This section presents frequency trends for TDP failures and demands. The data are normalized by reactor year for plants that have the equipment being trended. The rate methods described in Section 2 of the [Overview and Reference](#) document are used.

6.1 Standby TDP Engineering Trends

Figure 9 shows the trend for standby TDP start demands. Figure 10 shows the trend for TDP run ≤ 1 hour demands. Figure 11 shows the trend for the TDP run hours. Table 17, Table 18, and Table 19 provide the plot data, respectively.

Figure 12 shows the trend for TDP FTS events. Figure 13 shows the trend for TDP $FTR \leq 1H$ events, and Figure 14 shows the trend for the TDP $FTR > 1H$ events. Table 20, Table 22, and Table 23 provide the plot data, respectively. The standby systems from Table 2 are trended together for each figure.

Table 4 summarizes the failures by system and year for the FTS failure mode. Table 5 summarizes the failures by system and year for the $FTR \leq 1H$ failure mode. Table 6 summarizes the failures by system and year for the $FTR > 1H$ failure mode. Table 4, Table 5, and Table 6 only include systems where failures of that failure mode have been detected.

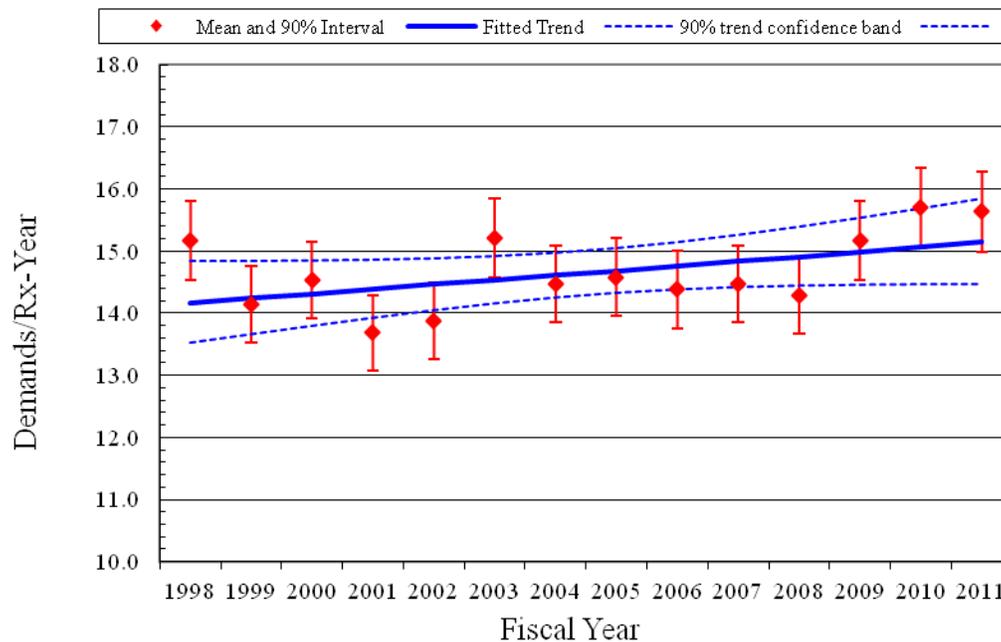

CNID, p-value = 0.0642

All StandbyTDP FTS 9-5-2012

Figure 9. Frequency (events per reactor year) of start demands, standby TDPs.

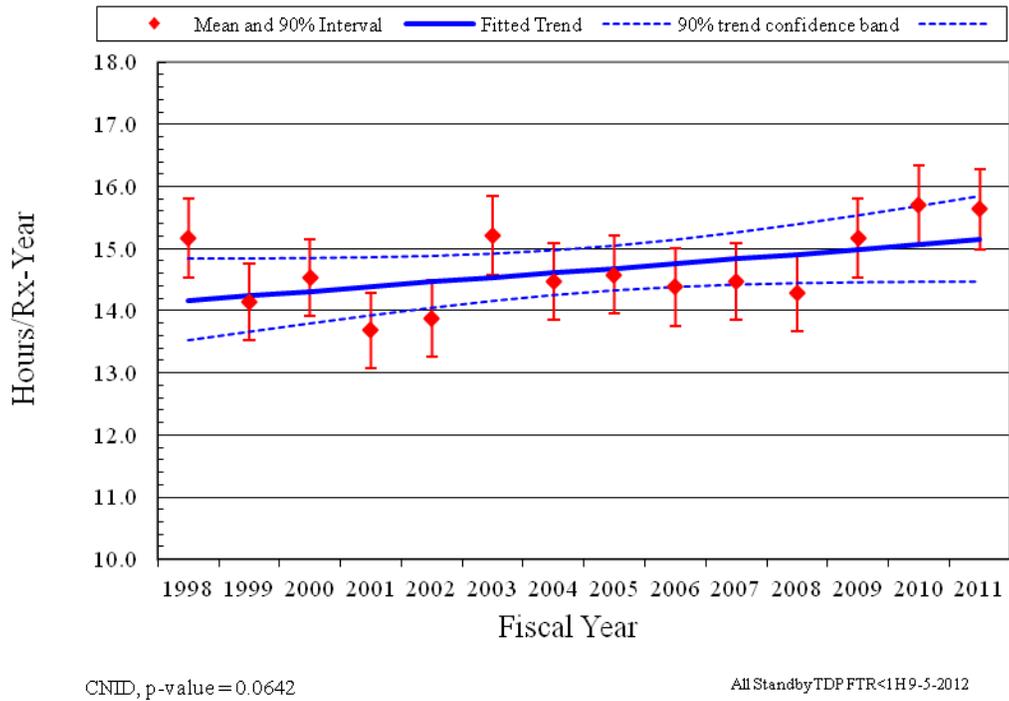


Figure 10. Standby TDP run hours per reactor critical year of run $\leq 1H$ hours.

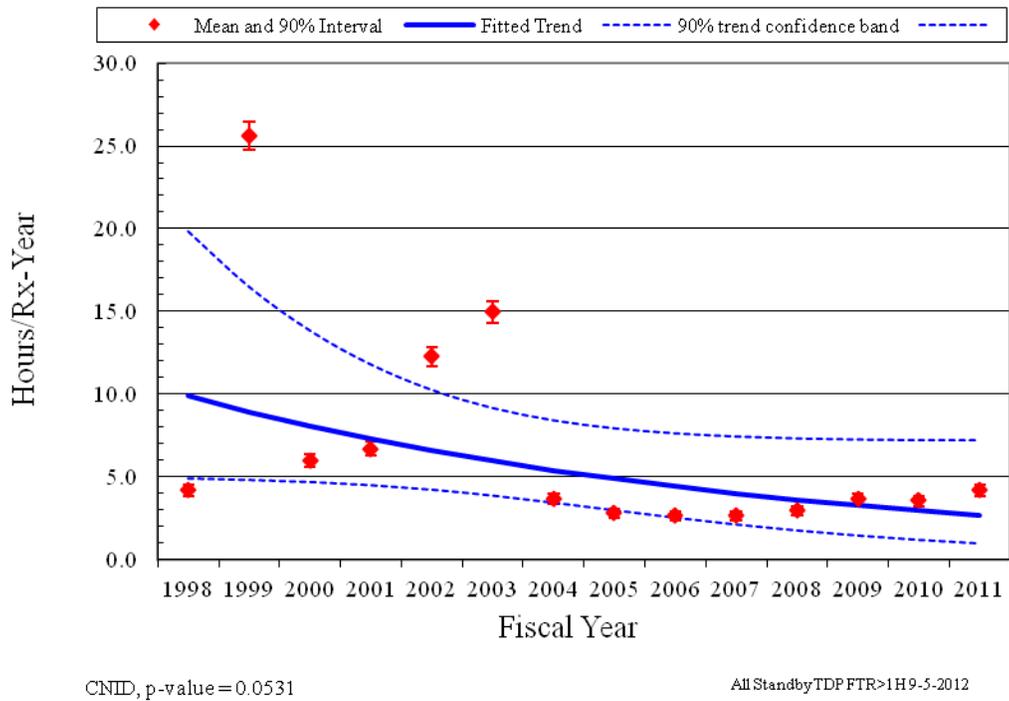


Figure 11. Standby TDP run hours per reactor critical year.

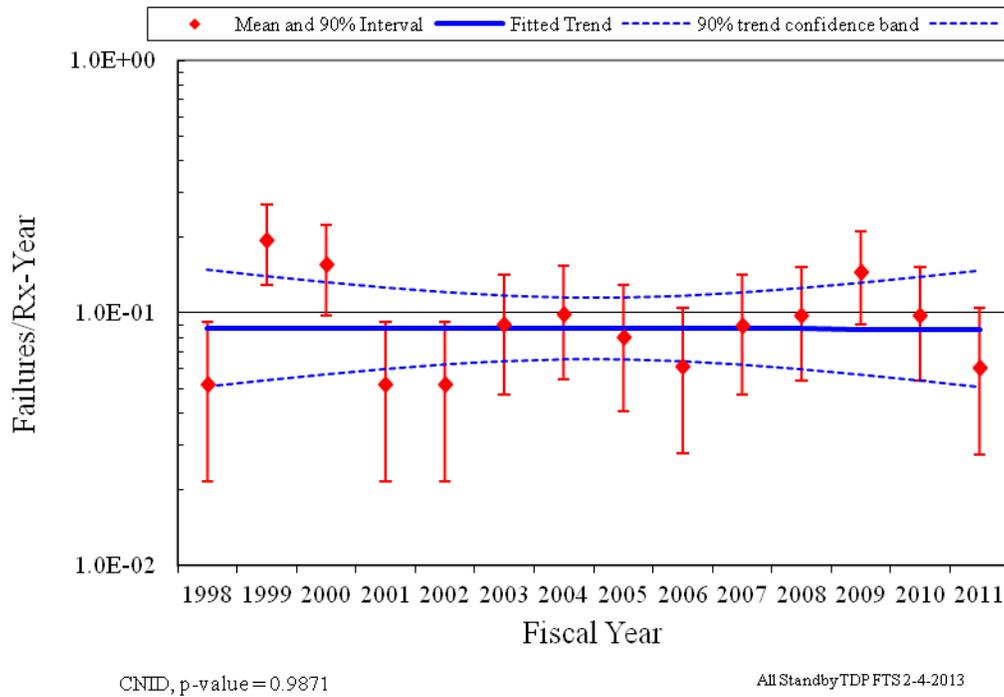


Figure 12. Frequency (events per reactor year) of FTS events, standby TDPs.

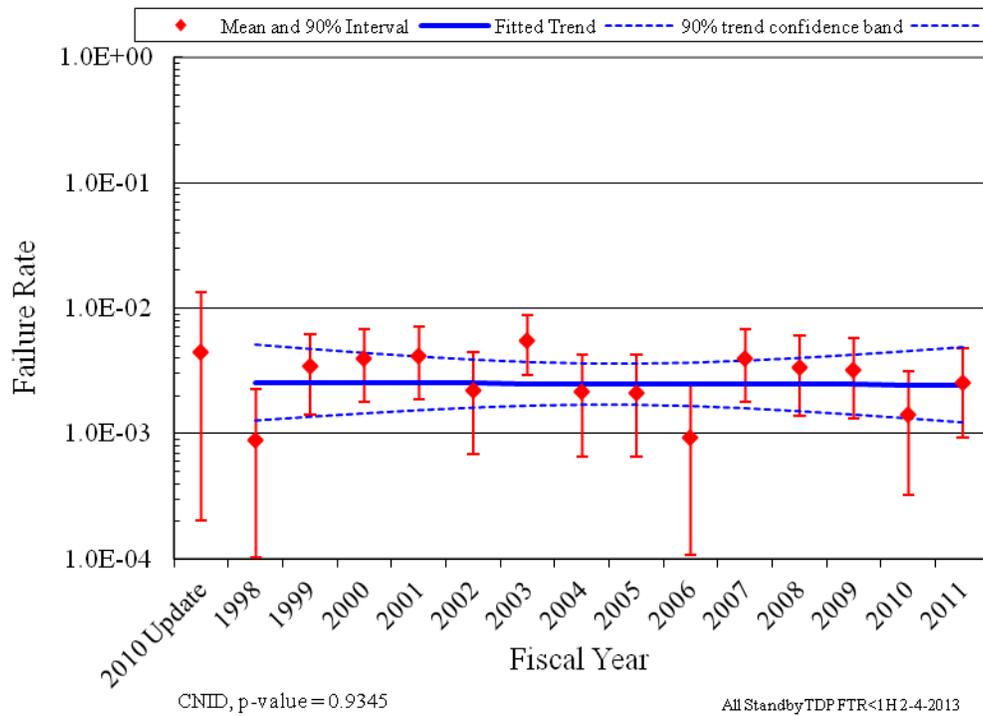


Figure 13. Frequency (events per reactor year) of FTR \leq 1H events, standby TDPs.

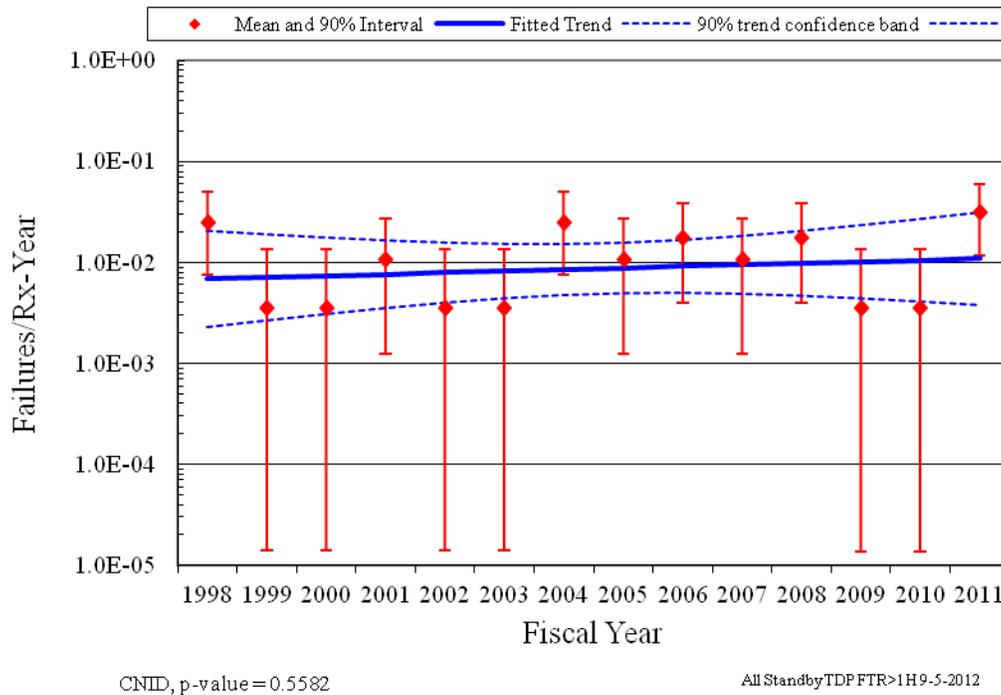


Figure 14. Frequency (events per reactor year) of FTR>1H events, standby TDPs.

6.2 Normally Running TDP Engineering Trends

Figure 15 shows the trend for TDP start demands and Figure 16 shows the trend for the TDP run hours. Table 23 and Table 24 provide the plot data, respectively.

Figure 17 shows the trend for TDP FTS events and Figure 18 shows the trend for the TDP FTR events. Table 25 and Table 26 provide the plot data, respectively. The normally running system (MFW) from Table 2 is trended for each figure.

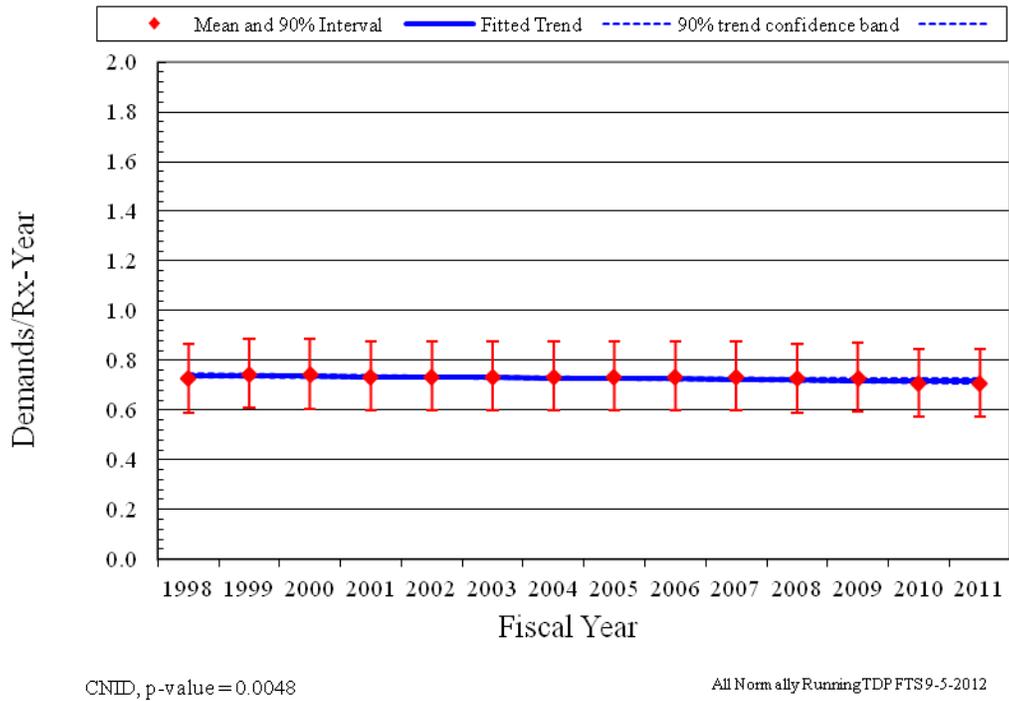


Figure 15. Frequency (events per reactor year) of start demands, normally running TDPs.

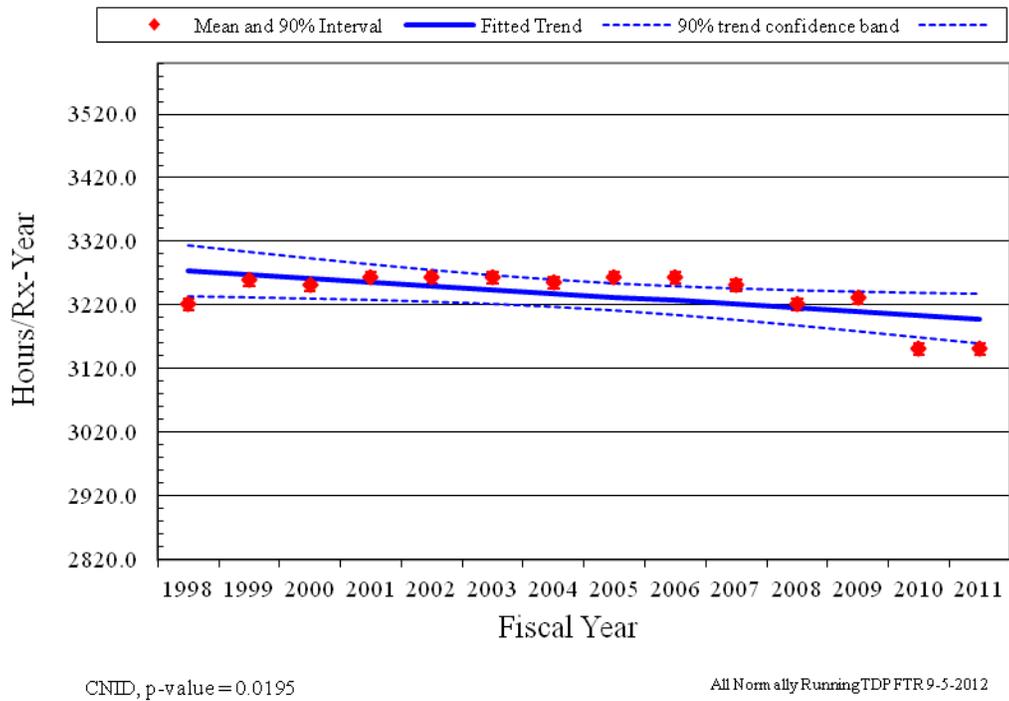


Figure 16. Normally running TDP run hours per reactor critical year.

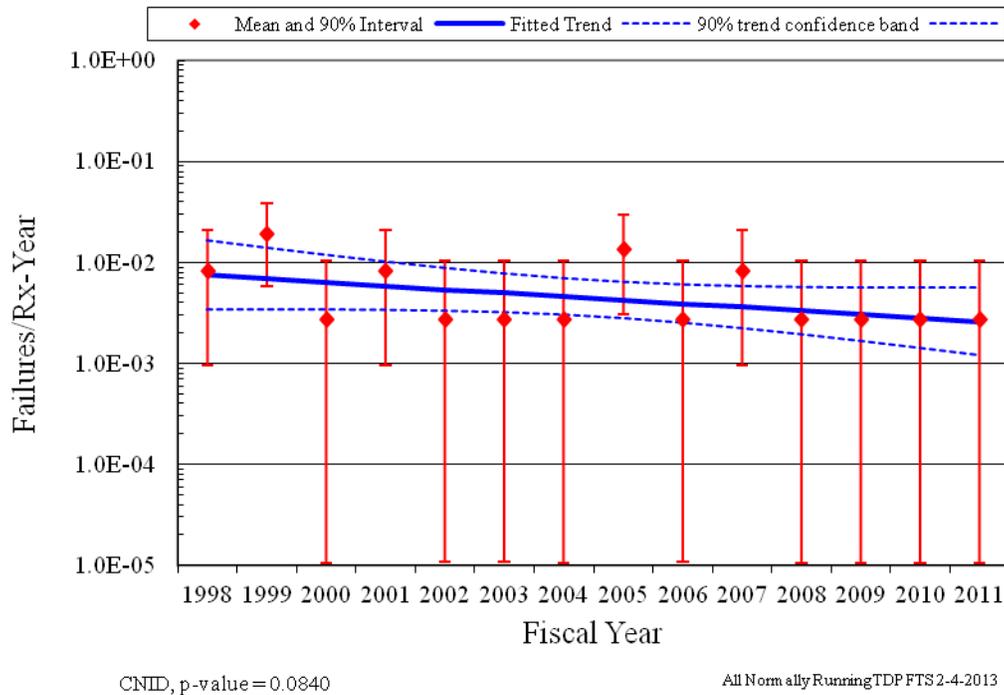


Figure 17. Frequency (events per reactor year) of FTS events, normally running TDPs.

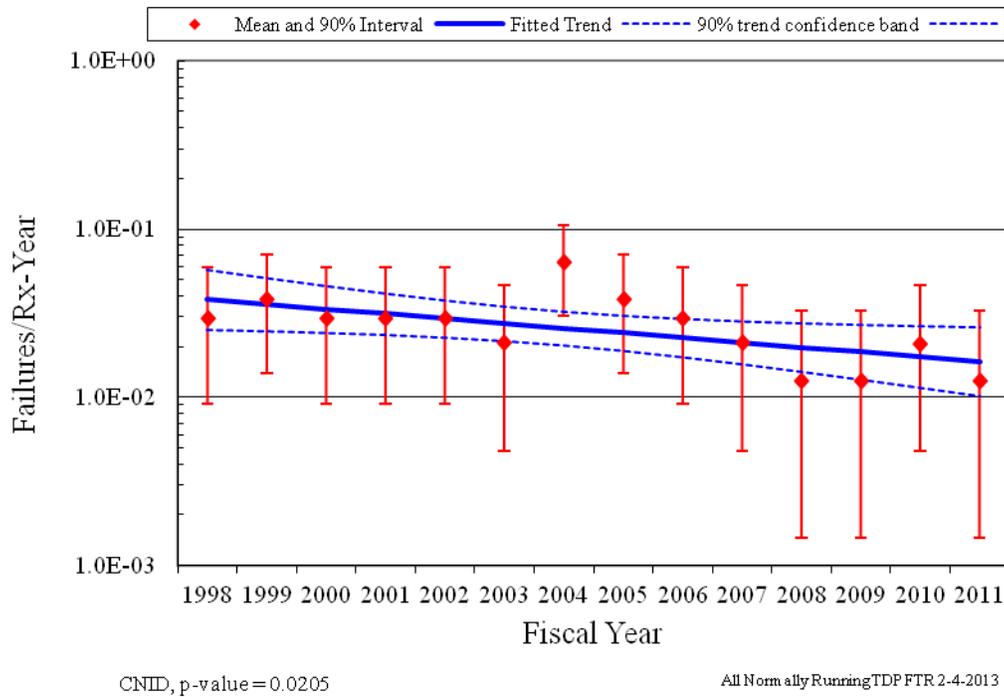


Figure 18. Frequency (events per reactor year) of FTR events, normally running TDPs.

Table 4. Summary of TDP failure counts for the FTS failure mode over time by system.

System Code	Valve Count	Valve Percent	FY 98	FY 99	FY 00	FY 01	FY 02	FY 03	FY 04	FY 05	FY 06	FY 07	FY 08	FY 09	FY 10	FY 11	Total	Percent of Failures
AFW	74	42.8%	4	6	5	3	2	5	4	4	3	4	3	10	4	3	60	42.3%
HCI	28	16.2%		5	5		3	2	1	2	1	3	3	3	3	2	33	23.2%
RCI	31	17.9%	1	9	6	2		2	5	2	2	2	4	2	3	1	41	28.9%
MFW	40	23.1%	1	3		1				2		1					8	5.6%
Total	173	100.0%	6	23	16	6	5	9	10	10	6	10	10	15	10	6	142	100.0%

Table 5. Summary of TDP failure counts for the FTR≤1H failure mode over time by system.

System Code	Valve Count	Valve Percent	FY 98	FY 99	FY 00	FY 01	FY 02	FY 03	FY 04	FY 05	FY 06	FY 07	FY 08	FY 09	FY 10	FY 11	Total	Percent of Failures
AFW	74	55.6%	1	4	2	4	2	7	3	1	1	2	3	4	2	1	37	62.7%
HCI	28	21.1%			2	1		2				2	2	1			10	16.9%
RCI	31	23.3%		1	2	1	1			2		2				3	12	20.3%
Total	133	100.0%	1	5	6	6	3	9	3	3	1	6	5	5	2	4	59	100.0%

Table 6. Summary of TDP failure counts for the FTR>1H and FTR failure mode over time by system.

System Code	Valve Count	Valve Percent	FY 98	FY 99	FY 00	FY 01	FY 02	FY 03	FY 04	FY 05	FY 06	FY 07	FY 08	FY 09	FY 10	FY 11	Total	Percent of Failures
AFW	74	42.8%	2			1			2	1	2		1			1	10	17.9%
HCI	28	16.2%							1				1			3	5	8.9%
RCI	31	17.9%	1									1					2	3.6%
MFW	40	23.1%	3	4	3	3	3	2	7	4	3	2	1	1	2	1	39	69.6%
Total	173	100.0%	6	4	3	4	3	2	10	5	5	3	3	1	2	5	56	100.0%

6.3 Comparison of EPIX TDP Unplanned Demand Results with Industry Results for Standby Components

An ongoing concern in the industry is whether a combination of test, non-test demand, and actual demand data adequately represents standby component performance during unplanned demands. This comparison evaluates the same dataset for standby components that is used for the overall trends shown in this document, but limits the failure data to those that are discovered during an ESF demand and the ESF demands reported in EPIX. The data are further limited to FY 2003 to present since the ESF demand reporting in EPIX is inconsistent prior to FY 2003.

The standby TDP ESF unplanned demand data covering FY 2003 – 2011 are summarized in Table 7. Consistency between the unplanned demand data and industry-average performance from Table 2 was evaluated using the predictive distribution approach outlined in the *Handbook of Parameter Estimation for Probabilistic Risk Assessment*, NUREG/CR-6823, Sections 6.2.3.5 and 6.3.3.4 [Reference 3]. Simulation is required.

The unplanned demand data were aggregated at the plant and system level (failures and demands). Assuming each plant and system can have a different failure probability, the industry-average distribution (from Table 2) was sampled for each plant and system. The predicted number of failure events for each plant and system was evaluated using the binomial distribution with the plant-specific failure probability and its associated number of demands. Then the total number of predicted failures was obtained by summing the individual plant results. This process was repeated 1000 times (Latin hypercube sampling), each time obtaining a total number of predicted failures. The 1000 sample results were ordered from high to low. Then the actual number of unplanned demand failures observed (listed in Table 7) was compared with this ordered sample to determine the probability of observing this number of failures or greater. If the probability was greater than 0.05 and less than 0.95, then the unplanned demand performance was considered to be consistent with the industry-average distribution obtained from the EPIX data analysis.

Table 7. Standby TDP unplanned demand performance comparison with industry-average performance.

Failure Modes	Plants	Demands or Hours	Failures	Expected Failures	Probability of \geq Failures	Consistent with Industry-Average Performance?
FTS	98	419	4	2.7	0.221	Yes
FTR<1H	98	236	7	1.0	0.000	No
FTR>1H	98	544.2	0	6.8	1.000	No
Total TDP Unreliability (8 hours)	98	419 and 544.2 h	11	10.6	0.003	No

The consistency checks using unplanned demand data indicate that the FTR>1H failure observations are not consistent with their industry-average distribution from Table 2, but seem to perform better (upper 5%). The unplanned demand FTS is consistent with the industry-average distribution. The unplanned demand failure mode observation FTR<1H and the Total TDP unreliability are not consistent and lie in the lower 95% (degraded performance) meaning that the TDP performs worse than the industry average distribution. Since most of the industry experience comes from testing, the unplanned demand performance appears to challenge the equipment more than the testing does.

6.4 TDP Engineering Analysis by Failure Modes

The engineering analysis of TDP failure sub-components, causes, detection methods, and recovery possibility are presented in this section. Each analysis divides the events into two periods: before July 2003 and after July 2003 (the start of the data begins in FY 1998 and the last date is FY 2011). This breakdown was chosen for two reasons: first, July 2003 represents a point in which the MSPI data collection attains a “higher level” of scrutiny; second, this date represents a point about half way through the full data period.

The second division of the events is by the failure mode determined after EPIX data review by the staff. See Section 7 for more description of failure modes.

TDP sub-component contributions to the three failure modes are presented in Figure 19. The sub-component contributions are similar to those used in the CCF database. The driver (specifically the governor) has the highest percentage contributions to failures for all three failure modes.

TDP cause group contributions to the three failure modes are presented in Figure 20. The cause groups are similar to those used in the CCF database. Table 8 shows the breakdown of the cause groups with the specific causes that were coded during the data collection. The most likely causes are human errors, design issues, and internal faults. Internal means that the cause was related to something within the TDP component such as a worn out part or the normal internal environment.

TDP detection methods to the three failure modes are presented in Figure 21. The most likely detection method for all failure modes is testing, which is the prevalent detection method for most standby components. The incidence of inspection for the FTS failure mode indicates that the equipment was observed to be unable to start without a demand (e.g., an alarmed condition, leaking oil, state of another component, etc.).

TDP recovery to the three failure modes are presented in Figure 22. The overall non-recovery to recovery ratio is approximately 4:1.

Table 8. Component failure cause groups.

Group	Specific Cause	Description
Design	Construction/installation error or inadequacy	Used when a construction or installation error is made during the original or modification installation. This includes specification of incorrect component or material.
Design	Design error or inadequacy	Used when a design error is made.
Design	Manufacturing error or inadequacy	Used when a manufacturing error is made during component manufacture.
External	State of other component	Used when the cause of a failure is the result of a component state that is not associated with the component that failed. An example would be the diesel failed due to no fuel in the fuel storage tanks.
External	Ambient environmental stress	Used when the cause of a failure is the result of an environmental condition from the location of the component.
Human	Accidental action (unintentional or undesired human errors)	Used when a human error (during the performance of an activity) results in an unintentional or undesired action.
Human	Human action procedure	Used when the procedure is not followed or the procedure is incorrect. For example: when a missed step or incorrect step in a surveillance procedure results in a component failure.
Human	Inadequate maintenance	Used when a human error (during the performance of maintenance) results in an unintentional or undesired action.

Group	Specific Cause	Description
Internal	Internal to component, piece-part	Used when the cause of a failure is a non-specific result of a failure internal to the component that failed other than aging or wear.
Internal	Internal environment	The internal environment led to the failure. Debris/Foreign material as well as an operating medium chemistry issue.
Internal	Setpoint drift	Used when the cause of a failure is the result of setpoint drift or adjustment.
Internal	Age/Wear	Used when the cause of the failure is a non-specific aging or wear issue.
Other	Unknown	Used when the cause of the failure is not known.
Other	Other (stated cause does not fit other categories)	Used when the cause of a failure is provided but it does not meet any one of the descriptions.
Procedure	Inadequate procedure	Used when the cause of a failure is the result of an inadequate procedure operating or maintenance.

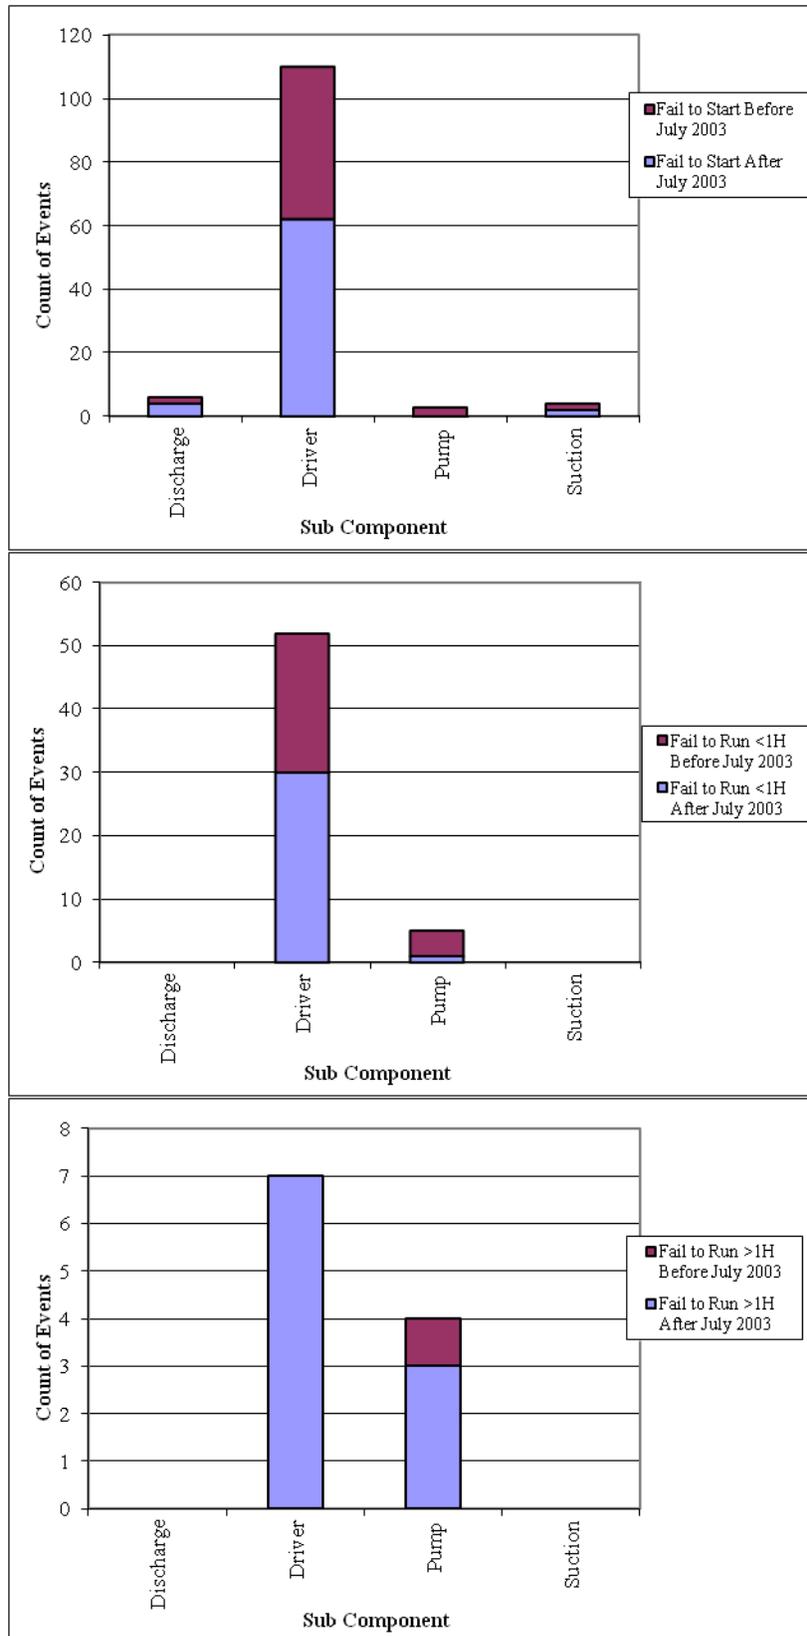


Figure 19. TDP failure breakdown by period, sub component, and failure mode.

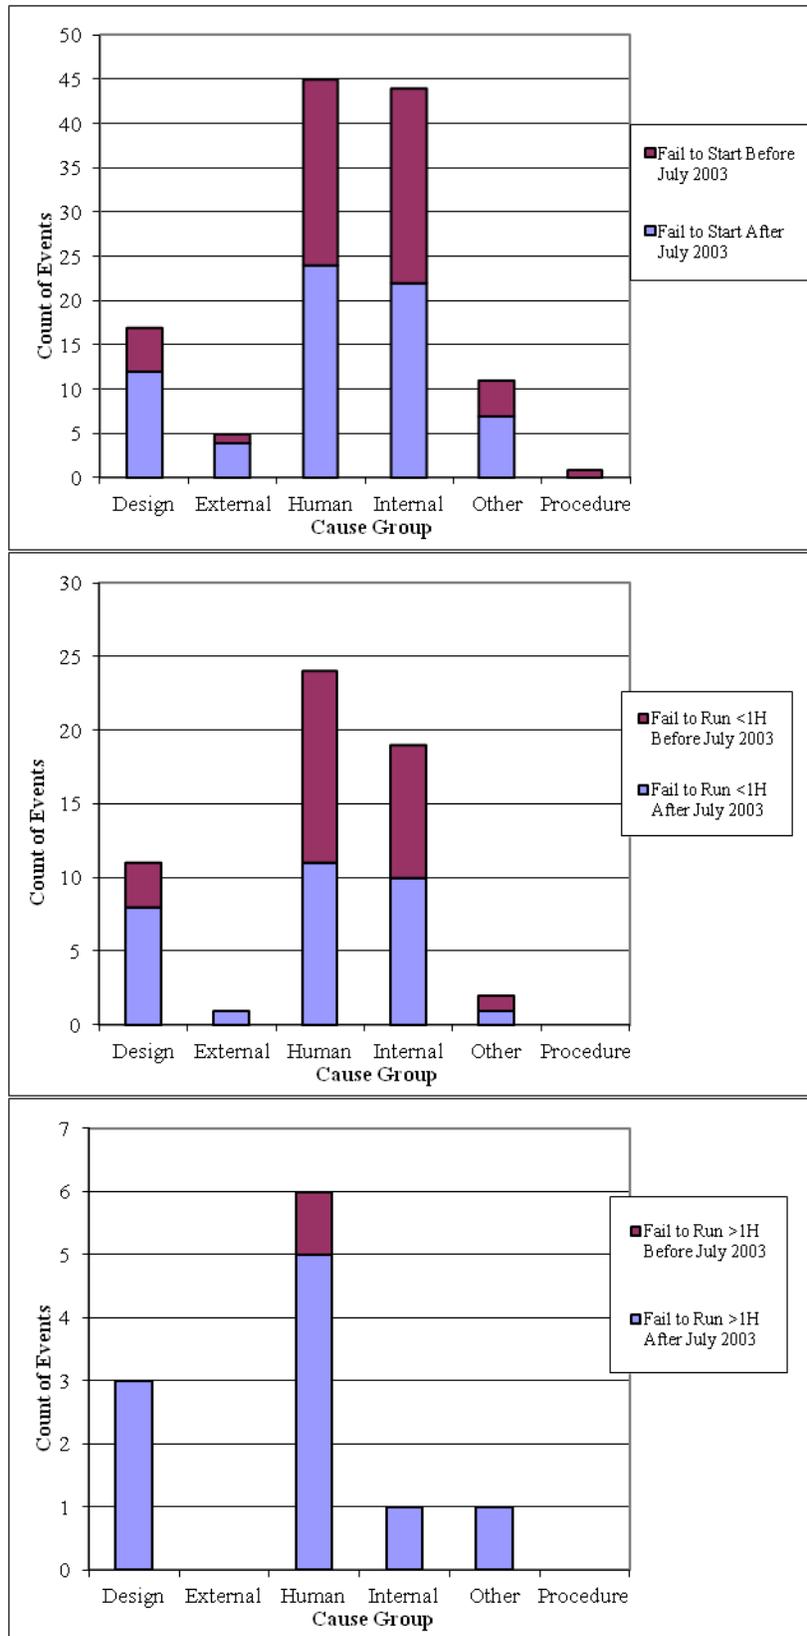


Figure 20. TDP breakdown by time period, cause group, and failure mode.

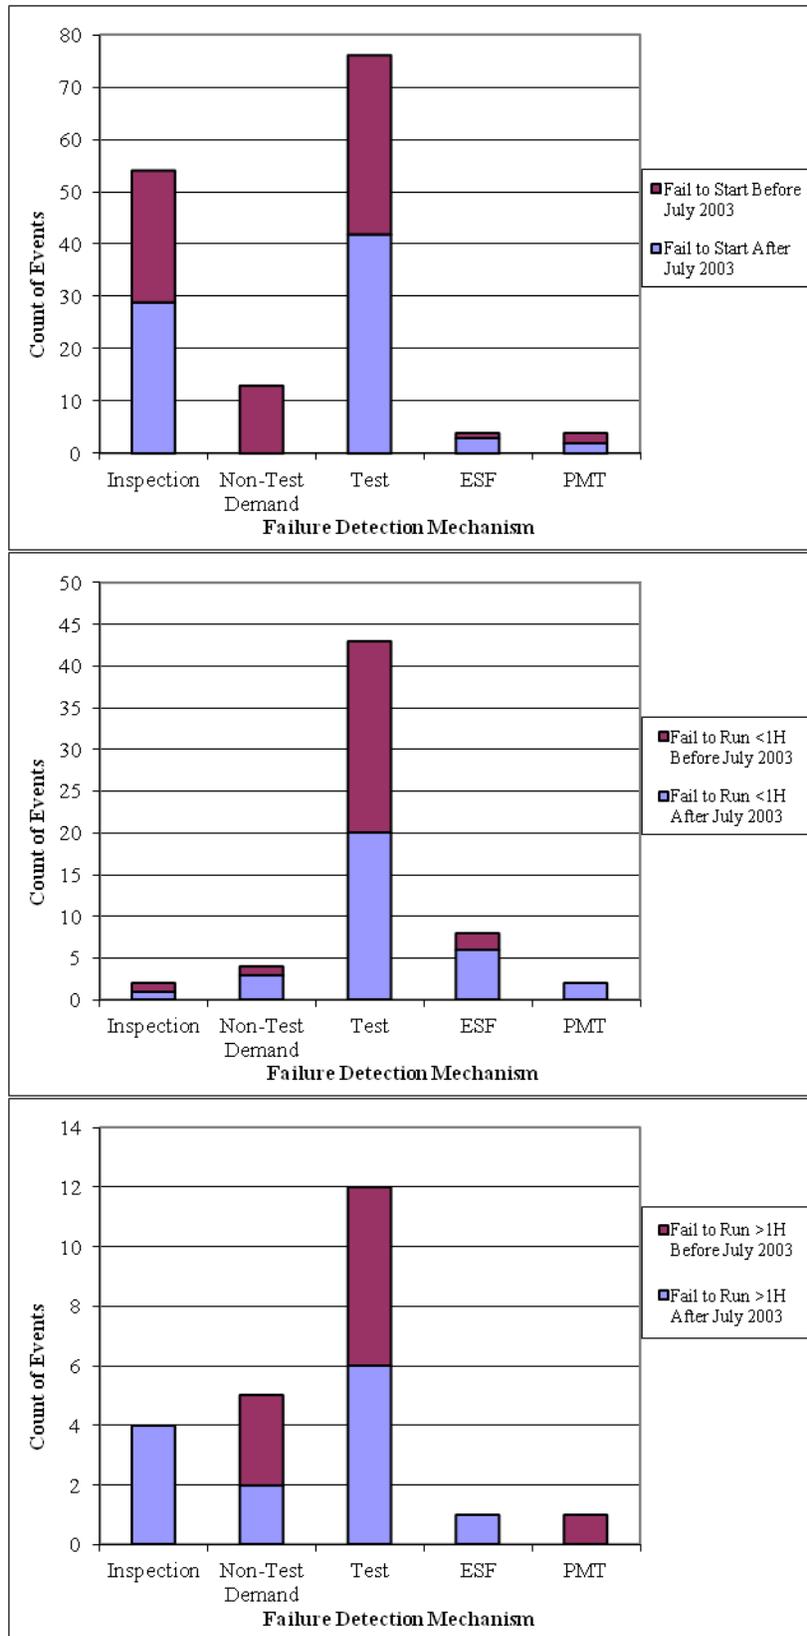


Figure 21. TDP component failure distribution by period, failure mode, and method of detection.

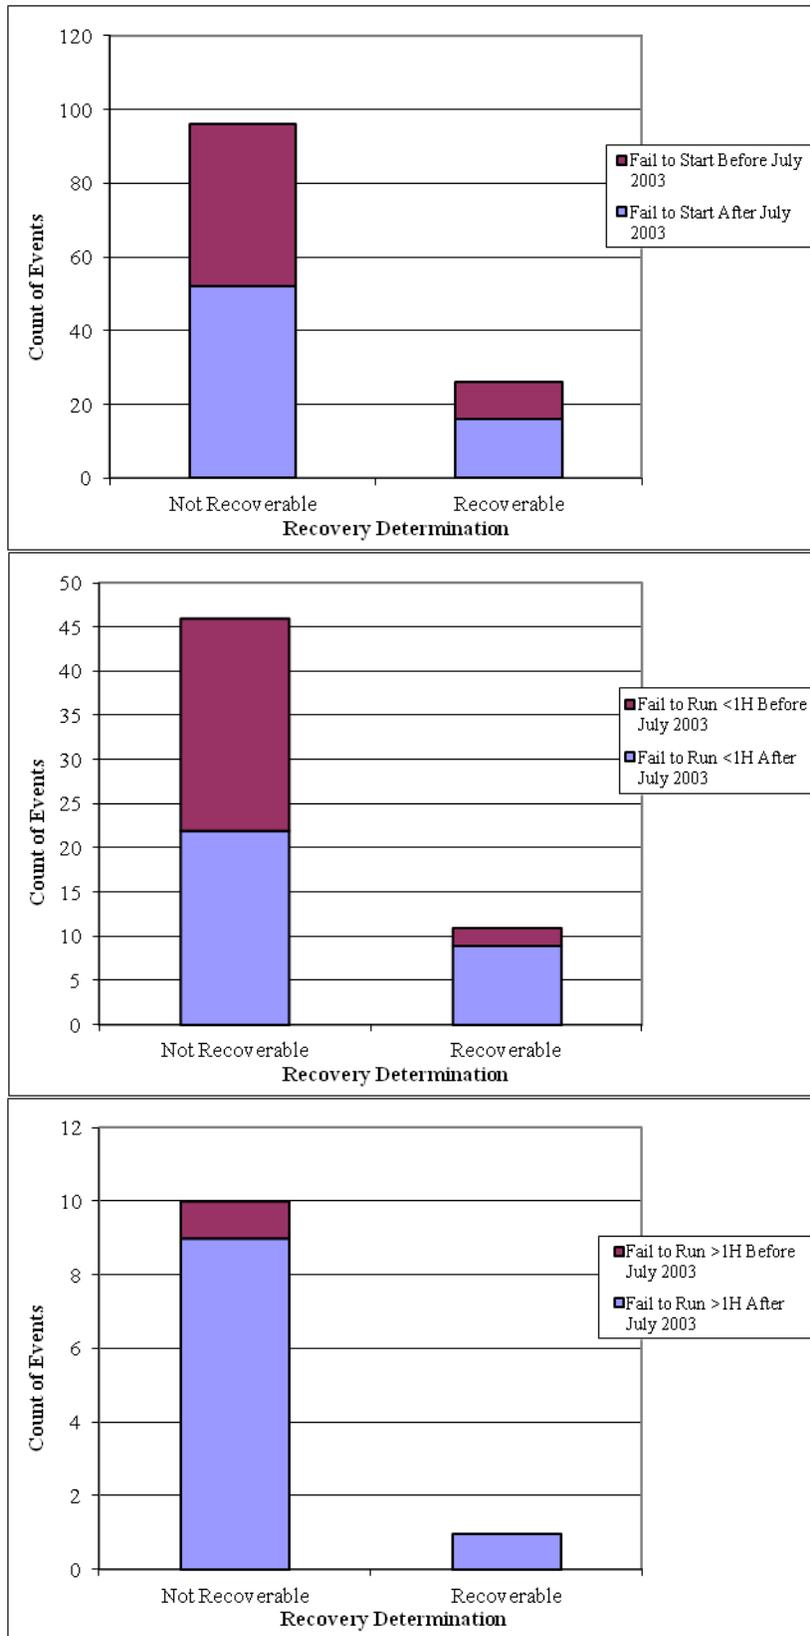


Figure 22. TDP component failure distribution by period, failure mode, and recovery.

7 TDP ASSEMBLY DESCRIPTION

The TDP is generally comprised of a pump, a turbine driver, and a governor. Most plant designs use a single stage “Terry Turbine”, whose piece-parts include a turbine trip and throttle valve, a mechanical overspeed trip mechanism, and a lubrication system. The various types of governors, used for turbine speed control are mostly manufactured by the Woodward Corporation. For the AFW system TDP, the governors are predominantly mechanical/hydraulic; pressure-compensated, and have a pneumatic remote speed-setting capability. For the RCIC and HPCI systems, the TDPs typically have a Woodward type EG-M electric/electronic governor and EG-R hydraulic actuators. Piece-parts of all governors include a turbine stop valve and a governor valve, while the EG-M usually includes a ramp generator/signal converter and other electrical controls.

The TDP failure modes include fail to start (FTS), fail to run for less or equal to one hour (FTR<1H), and fail to run beyond one hour (FTR>1H). These failure modes were used in NUREG/CR-6928 and are similar to those used in the MSPI Program.

Guidelines for determining whether a component event reported in EPIX is to be included in FTS, FTR<1H, or FTR>1H are similar to those used in the MSPI Program. In general, any circumstance in which the component is not able to meet the performance requirements defined in the probabilistic risk assessment (PRA) is counted. This includes conditions revealed through testing, operational demands, unplanned demands, or discovery. Also, run failures that occur beyond the typical 24-hour mission time in PRAs are included. However, certain events are excluded: slow starting times that do not exceed the PRA success criteria, conditions that are annunciated immediately in the control room without a demand, and run events that are shown to not have caused an actual run failure within 24 hours. Also, events occurring during maintenance or post-maintenance testing that are related to the actual maintenance activities are excluded. All of the TDP events within EPIX were reviewed to ensure that they were binned to the correct failure mode – FTS, FTR<1H, FTR>1H, or no failure. However, even given detailed descriptions of failure events, this binning still required some judgment and involves some uncertainty.

Guidelines for counting demands and run hours are similar to those in the MSPI Program. Start and run demands include those resulting from tests, operational demands, and unplanned demands. Demands during maintenance and post-maintenance testing are excluded. Similarly, run hours include those from tests, operational demands, and unplanned demands.

8 DATA TABLES

Table 9. Plot data for standby TDP FTS industry trend. Figure 1

FY/ Source	Failures	Demands	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
2010 Update						2.86E-04	1.99E-02	6.49E-03
1998	5	1531.1	6.11E-03	3.61E-03	1.03E-02	1.42E-03	6.09E-03	3.42E-03
1999	20	1428.3	6.08E-03	3.80E-03	9.72E-03	8.98E-03	1.86E-02	1.36E-02
2000	16	1471.4	6.05E-03	3.99E-03	9.17E-03	6.68E-03	1.51E-02	1.07E-02
2001	5	1381.1	6.02E-03	4.16E-03	8.70E-03	1.56E-03	6.71E-03	3.77E-03
2002	5	1400.9	5.99E-03	4.31E-03	8.31E-03	1.54E-03	6.62E-03	3.72E-03
2003	9	1536.3	5.96E-03	4.42E-03	8.02E-03	3.12E-03	9.27E-03	5.89E-03
2004	10	1465.1	5.93E-03	4.48E-03	7.85E-03	3.74E-03	1.05E-02	6.81E-03
2005	8	1471.8	5.90E-03	4.45E-03	7.81E-03	2.79E-03	8.84E-03	5.49E-03
2006	6	1452.0	5.87E-03	4.36E-03	7.90E-03	1.92E-03	7.27E-03	4.25E-03
2007	9	1466.0	5.84E-03	4.21E-03	8.10E-03	3.26E-03	9.69E-03	6.16E-03
2008	10	1460.7	5.81E-03	4.02E-03	8.39E-03	3.75E-03	1.05E-02	6.83E-03
2009	15	1546.0	5.78E-03	3.82E-03	8.76E-03	5.90E-03	1.37E-02	9.55E-03
2010	10	1599.8	5.75E-03	3.60E-03	9.19E-03	3.44E-03	9.67E-03	6.26E-03
2011	6	1593.9	5.73E-03	3.38E-03	9.67E-03	1.76E-03	6.66E-03	3.89E-03

Table 10. Plot data for standby TDP FTR≤1H industry trend. Figure 2

FY/ Source	Failures	Hours	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
2010 Update						2.06E-04	1.34E-02	4.43E-03
1998	1	1531.1	2.55E-03	1.27E-03	5.14E-03	1.03E-04	2.29E-03	8.79E-04
1999	5	1428.3	2.54E-03	1.36E-03	4.75E-03	1.43E-03	6.14E-03	3.43E-03
2000	6	1471.4	2.54E-03	1.46E-03	4.41E-03	1.79E-03	6.79E-03	3.95E-03
2001	6	1381.1	2.53E-03	1.55E-03	4.13E-03	1.89E-03	7.19E-03	4.18E-03
2002	3	1400.9	2.52E-03	1.63E-03	3.90E-03	6.88E-04	4.46E-03	2.22E-03
2003	9	1536.3	2.51E-03	1.69E-03	3.73E-03	2.96E-03	8.81E-03	5.55E-03
2004	3	1465.1	2.50E-03	1.73E-03	3.64E-03	6.61E-04	4.29E-03	2.13E-03
2005	3	1471.8	2.50E-03	1.72E-03	3.62E-03	6.58E-04	4.27E-03	2.13E-03
2006	1	1452.0	2.49E-03	1.68E-03	3.69E-03	1.08E-04	2.40E-03	9.22E-04
2007	6	1466.0	2.48E-03	1.61E-03	3.82E-03	1.80E-03	6.81E-03	3.96E-03
2008	5	1460.7	2.47E-03	1.52E-03	4.02E-03	1.40E-03	6.01E-03	3.36E-03
2009	5	1546.0	2.46E-03	1.42E-03	4.27E-03	1.33E-03	5.72E-03	3.20E-03
2010	2	1599.8	2.46E-03	1.32E-03	4.56E-03	3.23E-04	3.12E-03	1.41E-03
2011	4	1593.9	2.45E-03	1.22E-03	4.90E-03	9.40E-04	4.78E-03	2.54E-03

Table 11. Plot data for standby TDP FTR>1H industry trend. Figure 3

FY/ Source	Failures	Run Time (h)	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
2010 Update						9.12E-04	2.35E-03	1.56E-03
1998	3	422.1	6.13E-04	1.45E-04	2.59E-03	1.55E-03	1.01E-02	5.01E-03
1999	0	2589.3	6.92E-04	1.91E-04	2.50E-03	6.86E-07	6.70E-04	1.74E-04
2000	0	604.8	7.81E-04	2.50E-04	2.44E-03	2.23E-06	2.18E-03	5.67E-04
2001	1	674.3	8.82E-04	3.21E-04	2.42E-03	1.85E-04	4.11E-03	1.58E-03
2002	0	1238.0	9.96E-04	4.05E-04	2.45E-03	1.30E-06	1.27E-03	3.30E-04
2003	0	1512.3	1.12E-03	4.94E-04	2.56E-03	1.10E-06	1.07E-03	2.80E-04
2004	3	370.7	1.27E-03	5.80E-04	2.78E-03	1.67E-03	1.09E-02	5.41E-03
2005	1	283.9	1.43E-03	6.51E-04	3.15E-03	3.14E-04	6.97E-03	2.68E-03
2006	2	262.5	1.62E-03	6.99E-04	3.75E-03	1.06E-03	1.03E-02	4.64E-03
2007	1	264.9	1.83E-03	7.23E-04	4.61E-03	3.25E-04	7.22E-03	2.77E-03
2008	2	298.0	2.06E-03	7.27E-04	5.84E-03	9.97E-04	9.64E-03	4.35E-03
2009	0	369.5	2.33E-03	7.18E-04	7.55E-03	3.04E-06	2.97E-03	7.74E-04
2010	0	359.9	2.63E-03	6.98E-04	9.89E-03	3.09E-06	3.02E-03	7.86E-04
2011	4	426.0	2.97E-03	6.73E-04	1.31E-02	2.37E-03	1.20E-02	6.41E-03

Table 12. Plot data for normally running TDP FTS industry trend. Figure 4

FY/ Source	Failures	Demands	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
2010 Update						3.22E-04	2.80E-02	8.93E-03
1998	1	73.1	1.02E-02	4.59E-03	2.24E-02	1.30E-03	2.88E-02	1.12E-02
1999	3	74.8	9.40E-03	4.62E-03	1.90E-02	7.92E-03	5.05E-02	2.60E-02
2000	0	74.8	8.67E-03	4.61E-03	1.62E-02	1.25E-05	1.40E-02	3.63E-03
2001	1	74.3	8.00E-03	4.57E-03	1.39E-02	1.28E-03	2.86E-02	1.11E-02
2002	0	74.3	7.38E-03	4.49E-03	1.21E-02	1.26E-05	1.41E-02	3.65E-03
2003	0	74.4	6.80E-03	4.34E-03	1.07E-02	1.25E-05	1.40E-02	3.64E-03
2004	0	74.0	6.27E-03	4.10E-03	9.58E-03	1.26E-05	1.41E-02	3.66E-03
2005	2	74.2	5.79E-03	3.79E-03	8.83E-03	4.21E-03	4.02E-02	1.86E-02
2006	0	74.2	5.34E-03	3.42E-03	8.33E-03	1.26E-05	1.41E-02	3.65E-03
2007	1	74.4	4.92E-03	3.01E-03	8.03E-03	1.28E-03	2.86E-02	1.11E-02
2008	0	74.1	4.54E-03	2.62E-03	7.86E-03	1.26E-05	1.41E-02	3.65E-03
2009	0	74.2	4.19E-03	2.24E-03	7.79E-03	1.26E-05	1.41E-02	3.65E-03
2010	0	72.3	3.86E-03	1.91E-03	7.78E-03	1.27E-05	1.43E-02	3.70E-03
2011	0	72.2	3.56E-03	1.62E-03	7.81E-03	1.28E-05	1.43E-02	3.70E-03

Table 13. Plot data for normally running TDP FTR industry trend. Figure 5

FY/ Source	Failures	Run Time (h)	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
2010 Update						1.43E-06	2.29E-05	9.34E-06
1998	3	325316.6	1.17E-05	7.78E-06	1.76E-05	2.83E-06	1.83E-05	9.13E-06
1999	4	329181.6	1.10E-05	7.64E-06	1.58E-05	4.29E-06	2.18E-05	1.16E-05
2000	3	329181.6	1.03E-05	7.47E-06	1.42E-05	2.80E-06	1.82E-05	9.04E-06
2001	3	329485.8	9.65E-06	7.27E-06	1.28E-05	2.80E-06	1.81E-05	9.03E-06
2002	3	329577.1	9.05E-06	7.02E-06	1.17E-05	2.80E-06	1.81E-05	9.03E-06
2003	2	329501.0	8.49E-06	6.70E-06	1.08E-05	1.48E-06	1.43E-05	6.45E-06
2004	7	329607.5	7.96E-06	6.31E-06	1.00E-05	9.36E-06	3.22E-05	1.93E-05
2005	4	329516.2	7.46E-06	5.86E-06	9.51E-06	4.29E-06	2.18E-05	1.16E-05
2006	3	329592.3	7.00E-06	5.37E-06	9.12E-06	2.79E-06	1.81E-05	9.03E-06
2007	2	329577.1	6.56E-06	4.87E-06	8.83E-06	1.48E-06	1.43E-05	6.45E-06
2008	1	329409.8	6.15E-06	4.39E-06	8.62E-06	4.54E-07	1.01E-05	3.87E-06
2009	1	329592.3	5.77E-06	3.94E-06	8.44E-06	4.54E-07	1.01E-05	3.87E-06
2010	2	321355.9	5.41E-06	3.52E-06	8.30E-06	1.51E-06	1.46E-05	6.59E-06
2011	1	321310.3	5.07E-06	3.14E-06	8.18E-06	4.64E-07	1.03E-05	3.95E-06

Table 14. Plot data for all standby TDP unavailability trend. Figure 6

FY	UA Hours	Critical Hours	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
2010 Update						4.10E-03	2.33E-02	1.20E-02
1998	6265.3	641458.4	9.11E-03	8.24E-03	9.99E-03	3.51E-08	5.93E-02	1.17E-02
1999	8254.0	922022.2	8.98E-03	8.20E-03	9.76E-03	4.87E-04	2.71E-02	9.14E-03
2000	7839.5	954887.4	8.84E-03	8.15E-03	9.53E-03	8.50E-04	2.17E-02	8.15E-03
2001	7559.6	959741.4	8.71E-03	8.10E-03	9.32E-03	2.74E-04	2.51E-02	7.96E-03
2002	7612.4	961200.2	8.57E-03	8.03E-03	9.12E-03	5.30E-04	2.24E-02	7.83E-03
2003	8558.7	942160.3	8.44E-03	7.95E-03	8.93E-03	1.10E-03	2.33E-02	9.06E-03
2004	7526.6	970565.5	8.31E-03	7.84E-03	8.77E-03	5.68E-04	2.21E-02	7.80E-03
2005	6183.9	956879.4	8.17E-03	7.71E-03	8.64E-03	1.23E-03	1.53E-02	6.56E-03
2006	6816.9	973031.3	8.04E-03	7.55E-03	8.53E-03	7.48E-04	1.84E-02	6.97E-03
2007	7123.7	969478.2	7.90E-03	7.36E-03	8.45E-03	1.39E-04	2.47E-02	7.35E-03
2008	7488.7	971346.7	7.77E-03	7.16E-03	8.38E-03	1.20E-05	3.10E-02	7.64E-03
2009	7853.9	967221.8	7.64E-03	6.95E-03	8.33E-03	2.66E-05	3.21E-02	8.28E-03
2010	7955.2	953467.4	7.50E-03	6.72E-03	8.28E-03	1.07E-03	2.16E-02	8.46E-03
2011	7845.4	943250.0	7.37E-03	6.49E-03	8.24E-03	5.92E-04	2.41E-02	8.45E-03

Table 15. Plot data for Standby TDP unreliability trend. Figure 7

FY	Regression Curve Data Points			Plot Trend Error Bar Points		
	Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	3.26E-02	2.18E-02	4.34E-02	4.12E-02	7.13E-02	5.30E-02
1999	3.35E-02	2.39E-02	4.32E-02	1.99E-02	4.62E-02	2.99E-02
2000	3.45E-02	2.60E-02	4.30E-02	1.98E-02	5.01E-02	3.07E-02
2001	3.55E-02	2.79E-02	4.30E-02	1.89E-02	4.83E-02	2.78E-02
2002	3.64E-02	2.97E-02	4.32E-02	9.37E-03	3.80E-02	1.95E-02
2003	3.74E-02	3.13E-02	4.35E-02	1.72E-02	4.14E-02	2.69E-02
2004	3.84E-02	3.27E-02	4.41E-02	4.63E-02	7.83E-02	5.79E-02
2005	3.94E-02	3.36E-02	4.51E-02	2.71E-02	4.67E-02	3.44E-02
2006	4.03E-02	3.43E-02	4.64E-02	3.79E-02	5.93E-02	4.63E-02
2007	4.13E-02	3.46E-02	4.80E-02	3.09E-02	6.51E-02	4.35E-02
2008	4.23E-02	3.47E-02	4.98E-02	3.95E-02	8.95E-02	5.37E-02
2009	4.33E-02	3.47E-02	5.18E-02	1.97E-02	4.81E-02	3.01E-02
2010	4.42E-02	3.46E-02	5.39E-02	1.59E-02	3.94E-02	2.51E-02
2011	4.52E-02	3.44E-02	5.60E-02	5.37E-02	8.36E-02	6.56E-02

Table 16. Plot data for NR TDP unreliability trend. Figure 8

FY	Regression Curve Data Points			Plot Trend Error Bar Points		
	Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	2.04E-02	1.27E-02	3.25E-02	9.60E-03	7.07E-02	2.30E-02
1999	1.94E-02	1.28E-02	2.95E-02	2.44E-02	5.29E-02	3.52E-02
2000	1.86E-02	1.28E-02	2.69E-02	4.46E-03	2.54E-02	1.18E-02
2001	1.77E-02	1.28E-02	2.46E-02	1.07E-02	3.64E-02	1.91E-02
2002	1.69E-02	1.26E-02	2.27E-02	4.17E-03	2.64E-02	1.15E-02
2003	1.62E-02	1.24E-02	2.11E-02	4.80E-03	2.71E-02	1.27E-02
2004	1.55E-02	1.20E-02	1.98E-02	4.26E-03	2.59E-02	1.16E-02
2005	1.48E-02	1.15E-02	1.90E-02	1.84E-02	3.47E-02	2.53E-02
2006	1.41E-02	1.08E-02	1.84E-02	4.45E-03	2.22E-02	1.07E-02
2007	1.35E-02	1.00E-02	1.80E-02	1.04E-02	3.61E-02	1.85E-02
2008	1.28E-02	9.22E-03	1.79E-02	3.45E-03	3.41E-02	1.13E-02
2009	1.23E-02	8.43E-03	1.78E-02	3.48E-03	3.60E-02	1.20E-02
2010	1.17E-02	7.67E-03	1.79E-02	4.80E-03	2.52E-02	1.22E-02
2011	1.12E-02	6.95E-03	1.79E-02	4.21E-03	2.78E-02	1.22E-02

Table 17. Plot data for standby TDP start demands trend. Figure 9

FY	Demands	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	1531	101.0	1.42E+01	1.35E+01	1.48E+01	1.45E+01	1.58E+01	1.52E+01
1999	1428	101.0	1.42E+01	1.37E+01	1.48E+01	1.35E+01	1.48E+01	1.41E+01
2000	1471	101.3	1.43E+01	1.38E+01	1.48E+01	1.39E+01	1.52E+01	1.45E+01
2001	1381	101.0	1.44E+01	1.39E+01	1.49E+01	1.31E+01	1.43E+01	1.37E+01
2002	1401	101.0	1.45E+01	1.41E+01	1.49E+01	1.33E+01	1.45E+01	1.39E+01
2003	1536	101.0	1.45E+01	1.42E+01	1.49E+01	1.46E+01	1.59E+01	1.52E+01
2004	1465	101.3	1.46E+01	1.43E+01	1.50E+01	1.38E+01	1.51E+01	1.45E+01
2005	1472	101.0	1.47E+01	1.43E+01	1.50E+01	1.40E+01	1.52E+01	1.46E+01
2006	1452	101.0	1.48E+01	1.44E+01	1.51E+01	1.38E+01	1.50E+01	1.44E+01
2007	1466	101.4	1.48E+01	1.44E+01	1.53E+01	1.38E+01	1.51E+01	1.45E+01
2008	1461	102.3	1.49E+01	1.45E+01	1.54E+01	1.37E+01	1.49E+01	1.43E+01
2009	1546	102.0	1.50E+01	1.45E+01	1.55E+01	1.45E+01	1.58E+01	1.52E+01
2010	1600	102.0	1.51E+01	1.45E+01	1.57E+01	1.50E+01	1.63E+01	1.57E+01
2011	1594	102.0	1.51E+01	1.45E+01	1.58E+01	1.50E+01	1.63E+01	1.56E+01

Table 18. Plot data for standby TDP run \leq 1-hour run-hours trend. Figure 10

FY	Hours	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	1531	101.0	1.42E+01	1.35E+01	1.48E+01	1.45E+01	1.58E+01	1.52E+01
1999	1428	101.0	1.42E+01	1.37E+01	1.48E+01	1.35E+01	1.48E+01	1.41E+01
2000	1471	101.3	1.43E+01	1.38E+01	1.48E+01	1.39E+01	1.52E+01	1.45E+01
2001	1381	101.0	1.44E+01	1.39E+01	1.49E+01	1.31E+01	1.43E+01	1.37E+01
2002	1401	101.0	1.45E+01	1.41E+01	1.49E+01	1.33E+01	1.45E+01	1.39E+01
2003	1536	101.0	1.45E+01	1.42E+01	1.49E+01	1.46E+01	1.59E+01	1.52E+01
2004	1465	101.3	1.46E+01	1.43E+01	1.50E+01	1.38E+01	1.51E+01	1.45E+01
2005	1472	101.0	1.47E+01	1.43E+01	1.50E+01	1.40E+01	1.52E+01	1.46E+01
2006	1452	101.0	1.48E+01	1.44E+01	1.51E+01	1.38E+01	1.50E+01	1.44E+01
2007	1466	101.4	1.48E+01	1.44E+01	1.53E+01	1.38E+01	1.51E+01	1.45E+01
2008	1461	102.3	1.49E+01	1.45E+01	1.54E+01	1.37E+01	1.49E+01	1.43E+01
2009	1546	102.0	1.50E+01	1.45E+01	1.55E+01	1.45E+01	1.58E+01	1.52E+01
2010	1600	102.0	1.51E+01	1.45E+01	1.57E+01	1.50E+01	1.63E+01	1.57E+01
2011	1594	102.0	1.51E+01	1.45E+01	1.58E+01	1.50E+01	1.63E+01	1.56E+01

Table 19. Plot data for standby TDP run-hours trend. Figure 11

FY	Run Hours	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	422	101.0	9.87E+00	4.92E+00	1.98E+01	3.85E+00	4.52E+00	4.18E+00
1999	2589	101.0	8.93E+00	4.84E+00	1.65E+01	2.48E+01	2.65E+01	2.56E+01
2000	605	101.3	8.07E+00	4.71E+00	1.38E+01	5.58E+00	6.38E+00	5.97E+00
2001	674	101.0	7.30E+00	4.52E+00	1.18E+01	6.26E+00	7.10E+00	6.67E+00
2002	1238	101.0	6.60E+00	4.25E+00	1.02E+01	1.17E+01	1.28E+01	1.23E+01
2003	1512	101.0	5.96E+00	3.89E+00	9.15E+00	1.43E+01	1.56E+01	1.50E+01
2004	371	101.3	5.39E+00	3.46E+00	8.41E+00	3.36E+00	3.98E+00	3.67E+00
2005	284	101.0	4.87E+00	3.00E+00	7.93E+00	2.55E+00	3.09E+00	2.81E+00
2006	263	101.0	4.41E+00	2.55E+00	7.63E+00	2.35E+00	2.88E+00	2.61E+00
2007	265	101.4	3.98E+00	2.13E+00	7.44E+00	2.36E+00	2.89E+00	2.62E+00
2008	298	102.3	3.60E+00	1.77E+00	7.32E+00	2.64E+00	3.20E+00	2.92E+00
2009	370	102.0	3.26E+00	1.46E+00	7.25E+00	3.33E+00	3.95E+00	3.63E+00
2010	360	102.0	2.94E+00	1.20E+00	7.22E+00	3.23E+00	3.84E+00	3.53E+00
2011	426	102.0	2.66E+00	9.83E-01	7.21E+00	3.85E+00	4.52E+00	4.18E+00

Table 20. Plot data for standby TDP FTS events trend. Figure 12

FY	Failures	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	5	101.0	8.69E-02	5.11E-02	1.48E-01	2.15E-02	9.26E-02	5.18E-02
1999	20	101.0	8.68E-02	5.41E-02	1.39E-01	1.29E-01	2.68E-01	1.93E-01
2000	16	101.3	8.68E-02	5.71E-02	1.32E-01	9.79E-02	2.22E-01	1.55E-01
2001	5	101.0	8.68E-02	5.99E-02	1.26E-01	2.15E-02	9.26E-02	5.18E-02
2002	5	101.0	8.67E-02	6.24E-02	1.21E-01	2.15E-02	9.26E-02	5.18E-02
2003	9	101.0	8.67E-02	6.43E-02	1.17E-01	4.76E-02	1.42E-01	8.94E-02
2004	10	101.3	8.66E-02	6.54E-02	1.15E-01	5.44E-02	1.53E-01	9.85E-02
2005	8	101.0	8.66E-02	6.53E-02	1.15E-01	4.08E-02	1.30E-01	8.00E-02
2006	6	101.0	8.66E-02	6.42E-02	1.17E-01	2.77E-02	1.05E-01	6.12E-02
2007	9	101.4	8.65E-02	6.23E-02	1.20E-01	4.74E-02	1.41E-01	8.91E-02
2008	10	102.3	8.65E-02	5.97E-02	1.25E-01	5.39E-02	1.52E-01	9.76E-02
2009	15	102.0	8.64E-02	5.69E-02	1.31E-01	8.99E-02	2.10E-01	1.44E-01
2010	10	102.0	8.64E-02	5.39E-02	1.39E-01	5.40E-02	1.52E-01	9.79E-02
2011	6	102.0	8.63E-02	5.08E-02	1.47E-01	2.75E-02	1.04E-01	6.06E-02

Table 21. Plot data for standby TDP FTR≤1H events trend. Figure 13

FY	Failures	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	1	101.0	3.67E-02	1.84E-02	7.31E-02	1.56E-03	3.46E-02	1.33E-02
1999	5	101.0	3.67E-02	1.99E-02	6.78E-02	2.03E-02	8.71E-02	4.87E-02
2000	6	101.3	3.67E-02	2.13E-02	6.33E-02	2.60E-02	9.88E-02	5.74E-02
2001	6	101.0	3.67E-02	2.27E-02	5.94E-02	2.61E-02	9.90E-02	5.76E-02
2002	3	101.0	3.67E-02	2.40E-02	5.63E-02	9.60E-03	6.23E-02	3.10E-02
2003	9	101.0	3.67E-02	2.49E-02	5.41E-02	4.48E-02	1.33E-01	8.41E-02
2004	3	101.3	3.68E-02	2.55E-02	5.30E-02	9.57E-03	6.21E-02	3.09E-02
2005	3	101.0	3.68E-02	2.55E-02	5.30E-02	9.60E-03	6.23E-02	3.10E-02
2006	1	101.0	3.68E-02	2.50E-02	5.41E-02	1.56E-03	3.46E-02	1.33E-02
2007	6	101.4	3.68E-02	2.40E-02	5.63E-02	2.60E-02	9.87E-02	5.74E-02
2008	5	102.3	3.68E-02	2.28E-02	5.94E-02	2.00E-02	8.61E-02	4.82E-02
2009	5	102.0	3.68E-02	2.14E-02	6.33E-02	2.01E-02	8.63E-02	4.83E-02
2010	2	102.0	3.68E-02	2.00E-02	6.79E-02	5.03E-03	4.86E-02	2.19E-02
2011	4	102.0	3.68E-02	1.85E-02	7.32E-02	1.46E-02	7.43E-02	3.95E-02

Table 22. Plot data for standby TDP FTR>1H events trend. Figure 14

FY	Failures	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	3	101.0	6.88E-03	2.30E-03	2.05E-02	7.66E-03	4.97E-02	2.47E-02
1999	0	101.0	7.13E-03	2.69E-03	1.89E-02	1.39E-05	1.36E-02	3.53E-03
2000	0	101.3	7.38E-03	3.11E-03	1.75E-02	1.39E-05	1.35E-02	3.53E-03
2001	1	101.0	7.65E-03	3.56E-03	1.64E-02	1.24E-03	2.76E-02	1.06E-02
2002	0	101.0	7.93E-03	4.02E-03	1.56E-02	1.39E-05	1.36E-02	3.53E-03
2003	0	101.0	8.22E-03	4.45E-03	1.52E-02	1.39E-05	1.36E-02	3.53E-03
2004	3	101.3	8.52E-03	4.80E-03	1.51E-02	7.64E-03	4.96E-02	2.47E-02
2005	1	101.0	8.83E-03	5.00E-03	1.56E-02	1.24E-03	2.76E-02	1.06E-02
2006	2	101.0	9.15E-03	5.04E-03	1.66E-02	4.05E-03	3.91E-02	1.77E-02
2007	1	101.4	9.48E-03	4.93E-03	1.82E-02	1.24E-03	2.75E-02	1.06E-02
2008	2	102.3	9.82E-03	4.71E-03	2.05E-02	4.01E-03	3.88E-02	1.75E-02
2009	0	102.0	1.02E-02	4.43E-03	2.34E-02	1.38E-05	1.35E-02	3.51E-03
2010	0	102.0	1.05E-02	4.13E-03	2.70E-02	1.38E-05	1.35E-02	3.51E-03
2011	4	102.0	1.09E-02	3.81E-03	3.14E-02	1.17E-02	5.93E-02	3.16E-02

Table 23. Plot data for normally running TDP start demands trend. Figure 15

FY	Demands	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	73	101.0	7.40E-01	7.30E-01	7.50E-01	5.90E-01	8.67E-01	7.23E-01
1999	75	101.0	7.38E-01	7.29E-01	7.47E-01	6.08E-01	8.88E-01	7.42E-01
2000	75	101.3	7.36E-01	7.29E-01	7.44E-01	6.06E-01	8.86E-01	7.40E-01
2001	74	101.0	7.34E-01	7.28E-01	7.41E-01	5.99E-01	8.78E-01	7.33E-01
2002	74	101.0	7.32E-01	7.26E-01	7.38E-01	5.99E-01	8.78E-01	7.33E-01
2003	74	101.0	7.31E-01	7.25E-01	7.36E-01	5.99E-01	8.78E-01	7.33E-01
2004	74	101.3	7.29E-01	7.24E-01	7.34E-01	5.97E-01	8.75E-01	7.31E-01
2005	74	101.0	7.27E-01	7.22E-01	7.32E-01	5.99E-01	8.78E-01	7.33E-01
2006	74	101.0	7.25E-01	7.20E-01	7.30E-01	5.99E-01	8.78E-01	7.33E-01
2007	74	101.4	7.23E-01	7.17E-01	7.29E-01	5.97E-01	8.75E-01	7.30E-01
2008	74	102.3	7.21E-01	7.15E-01	7.28E-01	5.91E-01	8.67E-01	7.24E-01
2009	74	102.0	7.20E-01	7.12E-01	7.27E-01	5.93E-01	8.69E-01	7.26E-01
2010	72	102.0	7.18E-01	7.09E-01	7.26E-01	5.75E-01	8.48E-01	7.06E-01
2011	72	102.0	7.16E-01	7.07E-01	7.26E-01	5.75E-01	8.48E-01	7.06E-01

Table 24. Plot data for normally running TDP run hours trend. Figure 16

FY	Run Hours	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	325317	101.0	3.27E+03	3.23E+03	3.31E+03	3.21E+03	3.23E+03	3.22E+03
1999	329182	101.0	3.27E+03	3.23E+03	3.30E+03	3.25E+03	3.27E+03	3.26E+03
2000	329182	101.3	3.26E+03	3.23E+03	3.29E+03	3.24E+03	3.26E+03	3.25E+03
2001	329486	101.0	3.26E+03	3.23E+03	3.28E+03	3.25E+03	3.27E+03	3.26E+03
2002	329577	101.0	3.25E+03	3.23E+03	3.27E+03	3.25E+03	3.27E+03	3.26E+03
2003	329501	101.0	3.24E+03	3.22E+03	3.27E+03	3.25E+03	3.27E+03	3.26E+03
2004	329607	101.3	3.24E+03	3.22E+03	3.26E+03	3.25E+03	3.26E+03	3.25E+03
2005	329516	101.0	3.23E+03	3.21E+03	3.25E+03	3.25E+03	3.27E+03	3.26E+03
2006	329592	101.0	3.23E+03	3.21E+03	3.25E+03	3.25E+03	3.27E+03	3.26E+03
2007	329577	101.4	3.22E+03	3.20E+03	3.25E+03	3.24E+03	3.26E+03	3.25E+03
2008	329410	102.3	3.22E+03	3.19E+03	3.24E+03	3.21E+03	3.23E+03	3.22E+03
2009	329592	102.0	3.21E+03	3.18E+03	3.24E+03	3.22E+03	3.24E+03	3.23E+03
2010	321356	102.0	3.20E+03	3.17E+03	3.24E+03	3.14E+03	3.16E+03	3.15E+03
2011	321310	102.0	3.20E+03	3.16E+03	3.24E+03	3.14E+03	3.16E+03	3.15E+03

Table 25. Plot data for normally running TDP FTS events trend. Figure 17

FY	Failures	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	1	101.0	7.47E-03	3.41E-03	1.64E-02	9.54E-04	2.12E-02	8.13E-03
1999	3	101.0	6.89E-03	3.42E-03	1.39E-02	5.87E-03	3.81E-02	1.90E-02
2000	0	101.3	6.36E-03	3.41E-03	1.18E-02	1.06E-05	1.04E-02	2.71E-03
2001	1	101.0	5.86E-03	3.38E-03	1.02E-02	9.54E-04	2.12E-02	8.13E-03
2002	0	101.0	5.41E-03	3.32E-03	8.82E-03	1.07E-05	1.04E-02	2.71E-03
2003	0	101.0	4.99E-03	3.20E-03	7.77E-03	1.07E-05	1.04E-02	2.71E-03
2004	0	101.3	4.60E-03	3.03E-03	6.99E-03	1.06E-05	1.04E-02	2.71E-03
2005	2	101.0	4.24E-03	2.80E-03	6.44E-03	3.10E-03	3.00E-02	1.36E-02
2006	0	101.0	3.92E-03	2.53E-03	6.07E-03	1.07E-05	1.04E-02	2.71E-03
2007	1	101.4	3.61E-03	2.23E-03	5.85E-03	9.52E-04	2.11E-02	8.11E-03
2008	0	102.3	3.33E-03	1.94E-03	5.72E-03	1.06E-05	1.03E-02	2.69E-03
2009	0	102.0	3.07E-03	1.67E-03	5.66E-03	1.06E-05	1.04E-02	2.70E-03
2010	0	102.0	2.83E-03	1.42E-03	5.65E-03	1.06E-05	1.04E-02	2.70E-03
2011	0	102.0	2.61E-03	1.21E-03	5.67E-03	1.06E-05	1.04E-02	2.70E-03

Table 26. Plot data for normally running TDP FTR events trend. Figure 18

FY	Failures	Reactor Years	Regression Curve Data Points			Plot Trend Error Bar Points		
			Mean	Lower (5%)	Upper (95%)	Lower (5%)	Upper (95%)	Mean
1998	3	101.0	3.82E-02	2.53E-02	5.75E-02	9.11E-03	5.91E-02	2.94E-02
1999	4	101.0	3.57E-02	2.48E-02	5.14E-02	1.40E-02	7.11E-02	3.78E-02
2000	3	101.3	3.35E-02	2.43E-02	4.62E-02	9.09E-03	5.90E-02	2.94E-02
2001	3	101.0	3.13E-02	2.36E-02	4.17E-02	9.11E-03	5.91E-02	2.94E-02
2002	3	101.0	2.94E-02	2.27E-02	3.79E-02	9.11E-03	5.91E-02	2.94E-02
2003	2	101.0	2.75E-02	2.17E-02	3.49E-02	4.81E-03	4.65E-02	2.10E-02
2004	7	101.3	2.58E-02	2.04E-02	3.25E-02	3.04E-02	1.05E-01	6.29E-02
2005	4	101.0	2.41E-02	1.89E-02	3.08E-02	1.40E-02	7.11E-02	3.78E-02
2006	3	101.0	2.26E-02	1.73E-02	2.95E-02	9.11E-03	5.91E-02	2.94E-02
2007	2	101.4	2.12E-02	1.57E-02	2.85E-02	4.80E-03	4.64E-02	2.10E-02
2008	1	102.3	1.98E-02	1.41E-02	2.78E-02	1.46E-03	3.25E-02	1.25E-02
2009	1	102.0	1.86E-02	1.27E-02	2.72E-02	1.47E-03	3.26E-02	1.25E-02
2010	2	102.0	1.74E-02	1.13E-02	2.67E-02	4.77E-03	4.61E-02	2.08E-02
2011	1	102.0	1.63E-02	1.01E-02	2.63E-02	1.47E-03	3.26E-02	1.25E-02

9 REFERENCES

1. U.S. NRC, *Component Reliability Data Sheets Update 2010*, January 2012, <http://nrcoe.inl.gov/resultsdb/publicdocs/AvgPerf/ComponentReliabilityDataSheets2010.pdf>
2. S.A. Eide, et al, *Industry-Average Performance for Components and Initiating Events at U.S. Commercial Nuclear Power Plants*, U.S. Nuclear Regulatory Commission, NUREG/CR-6928, February 2007.
3. C.L. Atwood, et al. *Handbook of Parameter Estimation for Probabilistic Risk Assessment*, NUREG/CR-6823, September 2003.